



# Techno-economic analysis of PV-battery systems in Switzerland

**Journal Article****Author(s):**

[Han, Xuejiao](#) ; [Garrison, Jared](#) ; Hug, Gabriela

**Publication date:**

2022-04

**Permanent link:**


<https://doi.org/10.3929/ethz-b-000529028>

**Rights / license:**

[Creative Commons Attribution-NonCommercial-NoDerivatives 4.0 International](#)

**Originally published in:**

Renewable and Sustainable Energy Reviews 158, <https://doi.org/10.1016/j.rser.2021.112028>



# Techno-economic analysis of PV-battery systems in Switzerland

Xuejiao Han <sup>a,\*</sup>, Jared Garrison <sup>b</sup>, Gabriela Hug <sup>a</sup>

<sup>a</sup> Department of Information Technology and Electrical Engineering, ETH Zurich, Switzerland

<sup>b</sup> Research Center for Energy Networks, ETH Zurich, Switzerland

## ARTICLE INFO

### Keywords:

Battery storage  
Electricity price  
Optimization  
Self-consumption  
Solar photovoltaic  
Techno-economic model

## ABSTRACT

This paper presents a techno-economic optimization model to analyze the economic viability of a photovoltaic battery (PVB) system for different residential customer groups in Switzerland clustered based on their annual electricity consumption, rooftop size, annual irradiation and location. The simulations for a static investment model are carried out for years 2020–2050 and a comprehensive sensitivity analysis is conducted to investigate the impacts of individual parameters such as costs, load profiles, electricity prices and tariffs, etc. Results show that while combining photovoltaic (PV) with batteries already results in better net present values than PV alone for some residential customer groups today, the payback periods fluctuate between 2020 and 2035 due to the mixed effects of policy changes, costs and electricity price developments. The optimal PV and battery sizes increase over time and in 2050 the PV investment is mostly limited by the rooftop size. The economic viability of PVB system investments varies between different residential customer groups and the most attractive investment (i.e., that has the shortest payback period) is mostly accessible to residential customer groups with higher annual irradiation and electricity demand. In addition, investment decisions are highly sensitive to payback periods, future costs, electricity prices and tariff developments.

## 1. Introduction

### 1.1. Motivation

Solar energy is widely recognized as a solution to tackle climate change by lowering worldwide greenhouse gas emissions from the energy sector [1]. After a slowdown in 2018, the global solar energy market experienced a strong recovery in 2019, reaching 627 GW of cumulative PV installations [2]. This capacity accounts for nearly 3% of the global electricity demand and contributes to around a 5% reduction in worldwide electricity related CO<sub>2</sub> emissions [3]. Major drivers for the increasing PV penetration are the provision of subsidies and the overall decreasing costs. But subsidies that aim to compensate the capital-intensive PV investment are changing: feed-in tariffs are decreasing continuously while injection remunerations that are paid by the local distribution system operators (DSOs) (which will be referred to as the injection tariff in the following context) are already or will soon be lower than the retail tariff, which encourages self-consumption of PV generation. One of the means to enable the further development of PV installations is the use of battery storage, which is able to increase the PV self-consumption rate and also resolve the real-time imbalances caused by forecast errors [4]. In the past, high costs and limited combinations of use cases were the greatest barriers for battery

installations. However, as battery prices have declined dramatically over the last decade,<sup>1</sup> mainly driven by developments in the electric vehicle (EV) industry, batteries are now considered to be one of the most promising solutions to enable the transition towards renewable energy sources. In addition, with a proper combination of different applications, investments in battery storage units could already be attractive today [5].

### 1.2. Literature review

Techno-economic assessments of PVB systems have been extensively researched in recent years, especially in Germany where favorable renewable policies are implemented. As shown in Table 1, the existing techno-economic models can be categorized into optimization and simulation models, depending on whether the capacity of PV and battery units are optimization variables or simulated as exogenous parameters. While most of the existing studies focus on applications of PVB systems in residential sectors, some also investigate commercial and industry sectors [5,8,25,27].

Most of the existing research focuses on lithium-ion or lead–acid batteries, however, recent studies have shown that lithium-ion batteries are more viable, techno-economically, than lead–acid batteries [20,31]

\* Corresponding author.

E-mail addresses: [xuhan@eeh.ee.ethz.ch](mailto:xuhan@eeh.ee.ethz.ch) (X. Han), [garrison@fen.ethz.ch](mailto:garrison@fen.ethz.ch) (J. Garrison), [hug@eeh.ee.ethz.ch](mailto:hug@eeh.ee.ethz.ch) (G. Hug).

<sup>1</sup> Battery packs decreased from over 1100 \$/kWh in 2010 to around 150 \$/kWh in 2019.

**Table 1**  
Overview of existing techno-economic studies of the PVB system.

Ref.	Year	Region	Model type	Battery type	Economic indicator	Main sensitivity analysis	Load
[5]	2016	GE	Simulation	Lithium-ion	NPV	Battery application combination	S
[6]	2014	GE	Optimization	Lead-acid	NPV	Wholesale electricity price, retail tariff	R
[7]	2016	GE	Simulation	Lithium-ion	ROI	Battery parameters, electricity price, household size	R
[8]	2016	GE	Simulation	Lithium-ion	Annuity costs	Size and cost of PV and battery	R
[9]	2016	GE	Simulation	n/a	NPV	Load profile, EV profile	R
[10]	2016	SE	Optimization	Lithium-ion	SC, SS	Load profile, battery E-rate	R
[11]	2016	AU	Optimization	Lithium-ion & lead-acid	NPV	Load profile, PVB system cost, electricity tariff	R
[12]	2016	Europe	Simulation	n/a	LCOE	load profile, location	S
[13]	2017	PT	Simulation	Lead-acid	NPV, IRR, PI, DPP, LCOE	Consumption mode	S
[14]	2017	GE	Optimization	Lithium-ion	LCOE	Load profile	R
[15]	2017	GE, IE	Simulation	Lithium-ion	IRR	Load profile	S
[16]	2017	SE	Optimization	Hydrogen & lithium-ion	NPV	Operation strategy, PVB cost	R
[17]	2017	UK	Simulation	Lithium-ion	Net benefit	Battery degradation costs	R
[18]	2017	UK	Optimization	Lithium-ion	Annuity cost	Electricity tariff mode, battery capacity	R
[19]	2017	PT	Simulation	Lithium-ion	Electricity bill, NPV	Battery cost, interest rate	S
[20]	2017	BE	Simulation	Lithium-ion	LCOE	Size of PV and battery, storage price	R
[21]	2017	AU	Simulation	n/a	LCOE, NPV, IRR, DPBP, PBP	Size of PV and battery	R
[22]	2017	CH, UK,IT	Optimization	Lithium-ion & lead-acid	NPV	Location, battery technology	S
[23]	2018	CH	Optimization	Lithium-ion	NPV	PV and battery parameters and cost	R
[24]	2018	US	Simulation	Lithium-ion	LCOE	PVB cost, subsidy, discount rate, battery efficiency	S
[25]	2018	NE	Simulation	Lithium-ion	PI	Battery operation strategy, PVB system size and cost	R
[26]	2019	AU	Simulation	Lithium-ion	DPPB	Discount rate, feed-in-tariff	R
[27]	2019	CN	Simulation	Reused EV battery	NPV	Battery operation strategy	S
[28]	2019	FI	Simulation	Lithium-ion	Annuity cost	Electricity price and tariff mode	S
[29]	2020	IT	Simulation	n/a	NPV, LCOE, IRR, DPBP	Consumption level, investment scheme	S
[30]	2020	TH	Simulation	Lithium-ion	NPV, LCOE	Retail tariff, battery cost and size	R

Note: Definitions of economics indicators can be found in Section 3. Load type R and S stand for real-world and synthetic, respectively.

thanks to their recent drastic cost reductions and technology improvements. Some works also investigate hydrogen-based battery units [16] as well as reused electric vehicle batteries [27]. A review of different stationary electricity storage technologies can be found in [32].

Concerning battery operation strategies, most works [6,17,20,23,24] adopt simple rule-based strategies that aim to maximize the self-consumption rate, i.e. surplus PV generation is primarily used to charge the battery while any demand deficit is first satisfied by the stored energy in the battery. Some consider hybrid operation strategies, e.g. [19] applies batteries to peak shaving while [25] investigates uses in frequency reserve provision. In [5], the benefits of combining different applications of battery storage units are investigated. As mentioned in [16], simple rule-based strategies might underestimate the economic value of the investment and it is indeed important to adopt appropriate operation strategies in the analysis.

Since the input data and parameters such as costs, load profiles, wholesale and retail electricity prices, and local policies vary widely across published studies, different conclusions concerning the economics of PVB systems are drawn. While Refs. [17,21], published in 2017, state that the integration of batteries is not attractive at that time in the UK and Australia, [5,6], published in 2014 and 2016, indicate that it could be profitable for certain PVB in Germany. However, a comparatively low battery cost, i.e. 171 €/kWh + 172 €/kW, is assumed in [6]. The work in [24] shows that pairing battery energy storage systems (BESS) with PV systems can improve the economics and performance of a PVB system in the US and [19] identifies that the electricity bill could be reduced by 87% for the considered residential house in Portugal. Some studies investigate the break-even price

of battery units. For example, [8,9,18,23,30], which were published between 2016 and 2020 and simulated battery costs between 138–400 €/kWh, concluded that batteries could be profitable for commercial or residential sectors in Belgium, Germany, the UK, Switzerland and Thailand. In contrast, the study in [14] estimates that the break-even price of BESS in Germany ranges from 900 to 1200 €/kWh, whereas the work in [15] finds that battery costs of 500–600 €/kWh may make PVB systems generally profitable in Germany even without subsidies.

Based on this literature review, the identified research gaps are as follows:

- Most papers consider one single representative household for the entire country, i.e. one single price and one tariff for the PVB system, thereby neglecting price differences between different PV/battery categories, regional differences within one country, and different trade-offs faced by different household groups. This makes it difficult for policy-makers and regulators to learn from these studies.
- Most papers assume a simple rule-based battery operation strategy that aims to maximize the self-consumption rate, which underestimates the value of battery investments by ignoring the multi-applications case (e.g. price arbitrage).
- There is limited discussion about battery C-rates (i.e. the rate to quantify the maximum discharging rate of the battery as a reference to its maximum capacity) and most works only make energy-related cost assumptions.
- Specific types of load profiles are utilized for the analyses, e.g. scaled aggregated load profiles as well as synthetic profiles or real measurements taken from individual households. But there is

limited analysis of the impact of load profiles, which are expected to affect the PV self-consumption rate and the profitability of battery units.

- There is almost no analysis of the grid impact (e.g., maximum hourly injection and ramping etc.) of PVB system installations.

This work aspires to address these gaps and presents a static investment optimization model to assess the economics of PVB systems by minimizing the total investment and operational costs over a 30-year horizon. This work aims to (1) study the developments of the economic viability for PV-battery systems in Switzerland under different scenarios; and (2) present the potential challenges and opportunities that are of interest to different stakeholders (e.g., investors, retailers, system operators and policy-makers) using both quantitative and qualitative approaches. The optimization is conducted for a variety of residential customer groups in Switzerland in the years from 2020 through 2050. The customer group's heterogeneity is modeled using different rooftop sizes, annual irradiation and electricity consumption values, individual load profiles and geographical regions. These residential customer groups will be referred as customer groups for simplification purposes.

### 1.3. Status of PV and BESS in Switzerland

To support the implementation of the Energy Strategy 2050 [33] and a smooth transition towards a nuclear phaseout, Switzerland introduced different policies to encourage the deployment of renewables, especially PV investments, including: a feed-in tariff, investment subsidy, tax rebates and injection remunerations. PV is considered to be the most promising renewable resource in Switzerland due to the high social acceptance and the high deployment potential. The solar installation potential on rooftops and building facades in Switzerland is estimated to be 67 TWh (including 17 TWh from facades) [34]. As a result, the annual PV deployment increased from 26 MW in 2009 to 327 MW in 2019 [2], reaching a cumulative installed capacity of 2.5 GW and accounting for about 3.3% of the annual Swiss electricity demand in 2019 (i.e. 2.11 TWh of PV toward the 63.4 TWh demand). However, to achieve the ambitious net-zero greenhouse gas emissions targets by 2050 and to replace the phasing-out nuclear power, nearly 50 GW of new PV installations are required by 2050 according to Swissolar [35], which translates into around 1.6 GW of new installations annually.

According to data published by Swissolar [36], the battery storage market in Switzerland, although still quite small, has experienced an increase in annual installed capacity in the last few years. In 2018, 14.6 MWh were added, while in 2019 new installations increased to 20.4 MWh (including 20.3 MWh lithium-ion and 0.09 MWh lead-acid batteries), leading to a total battery storage capacity of 50.7 MWh. Additionally, the average system size increased from 9.1 kWh in 2018 to 13.5 kWh in 2019, which is consistent with the increase in the average installed PV unit size (from 19.4 kW in 2018 to 22.5 kW in 2019). In addition, around 15% of newly installed PV systems for single-family houses are equipped with battery storage units.

Based on these trends and developments, this work aims to answer questions such as:

- How are the PVB system economics affected by different customer groups that are categorized by rooftop sizes, annual electricity consumption and irradiation values, and geographical location of deployment?
- How does the optimal size of the PVB system change across different customer groups?
- What are the expected cumulative investments of the PVB system at both the regional and the national levels over the coming years?
- How sensitive is the economic viability of the PVB system to uncertainties related to e.g. costs, load profiles, electricity prices, etc. and which are the driving factors?

- What are the potential challenges and opportunities for investors, retailers and policy-makers?

The rest of the paper is organized as follows: Section 2 describes the data and assumptions in this research. Mathematical formulations of the proposed optimization model are given in Section 3. Section 4 analyzes the results and a further discussion of the results from different perspectives is given in Section 5. Finally, limitations of this work and conclusions are stated in Section 6 and Section 7, respectively.

## 2. Data

### 2.1. General assumptions

The proposed static investment model is simulated for the examined years 2020–2050 with a step of 5 years and the lifetime of the PVB system is assumed to be the same as the lifetime of PV, i.e. 30 years. Weighted average cost of capital (WACC) is set to be 4% [6] and the amortization period is the same as the lifetime of the invested unit. Since the lifetime of battery units are in general shorter than 30 years, a battery replacement is assumed and the potential remaining value of the last reinvested battery by the end of the PVB system lifetime is also calculated.

### 2.2. Rooftop potential and data clustering

We focus on rooftop solar for residential buildings and simulate each potential rooftop based on the Sonnendach dataset [37], which analyzes the solar generation potential for Switzerland by accounting for the roof area, orientation, tilt, utilization type and region. The high level of detail in this dataset thus enables a high level of granularity in our simulation results. According to [37], only buildings with roof areas greater than 10 m<sup>2</sup> and an annual solar irradiation higher than 1000 kWh/m<sup>2</sup> should be considered. The availability factors of the rooftops, which reduce the effective rooftop area, range between 42% and 80% depending on building types, roof sizes and tilt. This range accounts for the possible unavailability of the roof areas due to factors such as obstructions, windows and shadings (for details see page 7 of [37]). After accounting for these factors, the theoretically available rooftop area is reduced from 630 km<sup>2</sup> to 304 km<sup>2</sup> (i.e. 105 GW to 51 GW assuming 6 m<sup>2</sup>/kWp). The data are further processed by focusing on detached buildings (i.e. Einzelhaus) with warm water consumption that account for around 94% of the potential solar generations and exclude potentials from bridges, high buildings, buildings under construction, etc. Finally, the total potential rooftop area modeled in this work equals 224 km<sup>2</sup> (i.e. 37 GW), which corresponds to 3'795'145 rooftop data entries.

To lower the computational burden, these nearly 4 million data entries are clustered into different groups depending on their annual irradiation, roof sizes, warm water consumption (which is used to approximate their electricity consumption), and geographical regions:

- **IRR1-IRR5:** 5 irradiation categories in kWh/m<sup>2</sup>/year with a step of 150 kWh/m<sup>2</sup>/year, i.e. 1'000-1'150, 1'150-1'300, 1'300-1'450, 1'450-1'600 and >1'600;
- **A1-A40:** 40 roof size categories with a step of 6 m<sup>2</sup> between 12 m<sup>2</sup> and 60 m<sup>2</sup>, a step of 12 m<sup>2</sup> between 60 m<sup>2</sup> and 180 m<sup>2</sup>, a step of 30 m<sup>2</sup> between 180 m<sup>2</sup> and 600 m<sup>2</sup>, a step of 300 m<sup>2</sup> between 300 m<sup>2</sup> and 1'200 m<sup>2</sup>, a step of 600 m<sup>2</sup> between 1'200 m<sup>2</sup> and 2'400 m<sup>2</sup> and a step of 1'200 m<sup>2</sup> between 2'400 m<sup>2</sup> and 6'000 m<sup>2</sup>;
- **L1-L11:** 11 annual electricity consumption categories in kWh/year,<sup>2</sup> i.e. 0-1'600, 1'600-2'500, 2'500-3'500, 3'500-4'500,

<sup>2</sup> Since the annual electricity consumption data are not available, the annual electricity load is approximated as 125% of the warm water consumption [38–40]. The corresponding warm water consumption levels in kWh/year are: 0-1'280, 1'280-2'000, 2'000-2'800, 2'800-3'600, 3'600-4'400, 4'400-6'000, 6'000-10'400, 10'400-20'000, 20'000-24'000, 24'000-120'000 and >120'000.

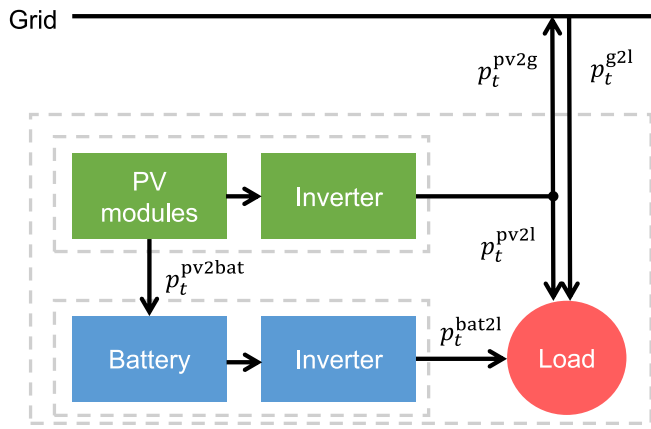


Fig. 1. Structure and power flows of the modeled PVB system.

4'500-5'500, 5'500-7'500, 7'500-13'000, 13'000-25'000, 25'000-30'000, 30'000-150'000 and >150'000;

- **REG1-REG26:** 26 regions corresponding to the 26 cantons in Switzerland.

After clustering, all data entries are categorized into  $5 \times 40 \times 11 \times 26 = 57'200$  residential customer groups which will be referred to as customer groups in the following context. The economic viability of PVB systems across the nearly 4 million rooftops considered in Switzerland is analyzed by evaluating each customer group using the median values from within each group. It is worth noting that the irradiation, roof size and electricity consumption categorizations should be adapted depending on the regions they are applied to. For example, while an average Swiss four-person household consumes 4500 to 5000 kWh of electricity per year (including electric hot water preparation) [41], the average household consumption in other regions might be higher or lower than this. Furthermore, in this work all of the resulting 57'200 groups are considered, although some might not be realistic (e.g., groups with large roof areas and low electricity consumption levels) and associated with a rooftop area of zero. Thus, a feasibility check could be used to exclude these groups from the analysis. Nevertheless, the feasibility check was not considered for the current modeling methodology, as it does not affect the final results, has negligible impact on the computational time, and might require additional effort for determining the range of reasonable combinations.

### 2.3. Parameters of the PVB system

Each one of the 57'200 customer groups faces an investment optimization problem for a PVB system. The fundamental model created for the PVB system consists of five components: the PV module, the battery unit, the hybrid inverter, the load and the grid. The structure of the PVB system and the power flows modeled between different components are illustrated in Fig. 1. The battery unit is assumed to be AC-coupled since compared to DC-coupling AC-coupling provides higher operational flexibility although it requires an additional battery inverter.

Table 2 gives the parameters for the considered PVB system using 2020 as the reference year. Based on historical PV installation data of Switzerland [36], although the average installed capacity of PV is increasing, most of the recent investments are still small-scale. For example, PV categories smaller than 1000 kWp account for almost all PV deployments in 2019, i.e. <30 kWp (40%), 30–100 kWp (16%) and 100–1000 kWp (39%), while >1000 kWp PV investments make up the remaining 5% of the total installed capacity. Therefore, five PV categories (i.e., 0–6 kWp, 6–10 kWp, 10–30 kWp, 30–100 kWp, >100 kWp) are considered with the minimum and maximum capacity limited

to 2 kWp and 50 MWp, which covers most of the potential investments and also corresponds to the range of PV units that could apply for the one-time investment subsidies in Switzerland [44]. The most commonly used batteries combined with a small-scale PV are lithium-ion and lead–acid batteries. Although lead–acid batteries have lower capital costs, lithium-ion batteries are proven to be more cost-efficient as a result of better depth of discharge (DOD) and cycle life [22,45]. In addition, the Swiss battery market is dominated by lithium-ion with only a negligible amount of lead–acid batteries installed in recent years; therefore only lithium-ion batteries are considered in this work. Note that the costs shown in Table 2 are for the year 2020 and are given as ranges since they vary according to the invested unit size and the considered scenario. As the assumed battery costs vary greatly between different studies, ranging from 250 €/kWh to 1883 \$/kWh, for comparative reasons, a list of the cost assumptions made by some recent works is provided in Table 3 along with the cost data selected in our simulations which are based on [43]. Future investment and operational costs for PV and batteries are estimated using projections from [42,46],<sup>3</sup> respectively. Details of the costs for future years are provided in Appendices A and B.

### 2.4. Load and generation profiles

Synthetic load profiles for individual households generated using the "LoadProfileGenerator" [56] with the location set as Munich are used. The generated load profiles represent the electricity consumption of electric appliances that are pre-configured based on market research. Then for each customer group, the hourly synthetic load profiles are scaled so that the total consumption matches the annual electricity demand approximated using the annual warm water energy consumption data provided by the Sonnendach dataset [57]. More specifically, based on the relationship of the average annual warm water energy consumption and the annual electricity consumption per person [38, 39], it is assumed that the annual electricity consumption is 1.25 times the annual warm water energy consumption. This approximation is necessary as electric energy consumption is not part of the Sonnendach data. Then for each customer group, the load profiles are scaled so that the total consumption matches the annual electricity demand approximated using the warm water consumption. To model the load profile of different consumption categories (i.e. L1-L11), different predefined household settings of "LoadProfileGenerator" detailed as follows are used:

- L1: predefined household CHR07 (i.e. single, employed) with an annual electricity consumption of 1'502 kWh;
- L2: predefined household CHR02 (i.e. couple, 30–64 age, both employed) in energy saving mode with an annual electricity consumption of 1'864 kWh;
- L3: predefined household CHR02 (i.e. couple, 30–64 age, both employed) in energy intensive mode with an annual electricity consumption of 3'346 kWh;
- L4: predefined household CHR04 (i.e. couple, 30–64 age, 1 employed, 1 at home) with an annual electricity consumption of 4'677 kWh;
- L5: predefined household CHR03 (i.e. family, 1 child, both employed) with an annual electricity consumption of 5'460 kWh;
- L6: predefined household CHR05 (i.e. family, 3 children, both employed) with an annual electricity consumption of 6'689 kWh;
- L7-L11: a combination of predefined household CHR02 and CHR03 with an annual electricity consumption of 8'826 kWh. The electricity consumption of buildings with multiple households are assumed to fall into these consumption categories.

<sup>3</sup> Data for missing years are estimated using an interpolation or extrapolation method.



**Table 2**  
Parameters of the PVB system.

Category	Parameter	Adopted value	Source
PV	Investment cost	754~2786 €/kWp	[42]
	Operational cost	1.7~2.6 cent/kWh	[42]
	Module efficiency	17%	[42]
	Inverter efficiency	98%	[42]
	Performance ratio	80%	[42]
	Lifetime	30 years	[42]
	Area requirement	6 m <sup>2</sup> /kWp	[42]
Battery	Investment cost	295~459 €/kWh + 249~388 €/kW	[43]
	Operational cost	3.7~5.7 €/kW/year + 1.1~1.7 €/MWh	[43]
	Lifetime	13 years	[43]
	Depth of discharge	100%	[43]
	Charging/discharging efficiency	93%	[43]
	Inverter efficiency	100%	n/a
	Self-discharge	0%	[43]
PVB system	Degradation rate	0.5% per year	[14,42]

Note: Original values are converted to Euros based on the exchange rate of 0.91 EUR/CHF and 0.85 EUR/USD.

**Table 3**  
Overview of lithium-ion battery system costs.

Ref.	Year	Country	Spec.	Cost			Future development
				Energy-related	Power-related	Others	
[8]	2016	GE	n/a	2015: 1000 €/kWh	n/a	n/a	2035: 375 €/kWh
[9]	2016	GE	n/a	2018: 500 €/kWh	n/a	OM: 1% of inv.	n/a
[15]	2016	GE	0-100 kWh	500 €/kWh	n/a	Instal.: 1330 €	n/a
[47]	2015	US	BEV	2014: 300 \$/kWh	n/a	n/a	Learning rate: 6~9%
[48]	2016	US	8-hour, utility-scale	2015: 500 \$/kWh	4000 \$/kW	n/a	2015-2050: 34%, 57% and 81% reductions
[49]	2016	US	3kW/6kWh, DC-coupled	500 \$/kWh for battery	600 \$/kW inverter	n/a	n/a
[14]	2017	GE	n/a	1000 €/kWh	n/a	n/a	n/a
[18]	2017	UK	n/a	990 \$/kWh	n/a	n/a	n/a
[19]	2017	PT	10.2 kWh	550 €/kWh (480 €/kWh for battery)	n/a	n/a	n/a
[20]	2017	BE	0.5 kW/kWh	600 €/kWh	500 €/kW inverter	Instal.: 200 €	n/a
[21]	2017	AU	4-12 kWh	300 AUD/kWh	700 AUD/kW + 400 AUD/kW inverter	n/a	n/a
[22]	2017	CH,UK,IT	128 Wh/kg	320 €/kWh	n/a	Instal.: 100 €+ 2€/kg Inverter: 800 €	n/a
[32]	2017	n/a	1 MW, NCA/LTO	923 €/kWh	162 €/kW	n/a	n/a
[50]	2017	n/a	n/a	2016: 273 \$/kWh for battery	n/a	n/a	Learning rate: 19%
[51]	2017	n/a	n/a	2016: 200~840 \$/kWh	n/a	n/a	2030: 145~480 \$/kWh
[52]	2017	GE	0.33 C-rate	2016: 1883 \$/kWh	n/a	OM: 0	2030: 524 \$/kWh; 2040: 397 \$/kWh
[23]	2018	CH	n/a	250~1000 €/kWh	n/a	OM: 1% of inv. Repl.: 50% of inv.	n/a
[24]	2018	n/a	14 kWh Powerwall	2017: 393 \$/kWh	n/a	BOS: 700 \$ Instal.: 1000 \$	In 15 years: battery -50%, instal. -25%, inverter 0.12 \$/W
[25]	2018	NE	25-year lifetime	200 €/kWh	150 €/kW BOS + 150 €/kW EPC	OM: 1% of inv.	n/a
[53]	2018	n/a	n/a	2020: 165~548 \$/kWh for battery	n/a	n/a	2030: 120~250 \$/kWh
[54]	2018	US	10kW/40kWh	639~780 \$/kWh	130~174 \$/kW	OM: 1.79~2.2% of inv.	n/a
[26]	2019	AU	n/a	900 AUD/kWh	n/a	n/a	-8%/year
[28]	2019	FN	n/a	2020: 100~200 €/kWh	80~110 €/kW	Instal.: 200~400 €/kWh	n/a
[43]	2019	n/a	n/a	2015: 802 \$/kWh	678 \$/kW	OM: 10 \$/kW/a + 3 \$/MWh	2020-2050 costs: 55% ~14% of 2015 cost
[55]	2019	n/a	1kW-100MW	2018: 271 \$/kWh	388 \$/kW BOP	OM: 10 \$/kW/a + 0.3 \$/MWh Instal.: 101 \$/kWh	2025: 306 \$/kW + 189 \$/kWh + 96 \$/kWh instal. OM: 8 \$/kW/a + 0.3 \$/MWh -4%/a ~ -12%/a
[30]	2020	TH	6.5 kWh/kW, AC-coupled	500~1000 \$/kWh	n/a	n/a	

Solar irradiation profiles are based on historical hourly data from MeteoSwiss [58], using data of stations located in the capital or the main city to represent the profile of each canton. The irradiation profiles are then scaled according to the annual irradiation category

collected from the Sonnendach data. A perfect forecast of PV generation is assumed and the generation profile is calculated as the production resulting from the invested module area, module efficiency, inverter

efficiency, performance ratio and the irradiation profile (a summary of the PVB system parameter inputs used in this work is given in Table 2).

## 2.5. Policies and regulations

To account for the impacts of the legislative and regulatory framework on the investment decisions for PV units, available subsidies, DSO injection tariffs and tax rebates are considered:

- **Subsidies:** Currently, both an output-based feed-in-tariff subsidy scheme and a capacity-based investment subsidy scheme exist in Switzerland. However, the feed-in-tariff scheme is expected to expire in 2022 and due to the long waiting list, only PV units registered before July 2012 could qualify to benefit from it [59]. From 2020 on, units above 100 kWp within the feed-in-tariff scheme are obliged to participate in direct marketing that aims to replace the fixed tariff with a more market-oriented remuneration tariff [60]. Units ranging from 2 kWp to 50 MWp can apply for the one-time investment subsidy that could cover up to 30% of their investment costs based on the installed capacity and the PV category [44]. The current one-time investment subsidy is valid until 2030, but recent reports indicate that the Swiss federal council is planning a possible extension to 2035 [61].
- **DSO injection tariffs:** To account for income earned from PV generation that is fed back into the local electricity grid, the injection tariffs that are set by regional DSOs are included. Since these injection tariffs vary from DSO to DSO, data available from [62] are used to make an estimation of the average value for each canton as DSO regions and cantons are only partially congruent. The inclusion of this injection tariff is important for quantifying the revenue earned from PV generation that is not self consumed. Even more critically, it is needed to quantify the economic benefits of the PV-batteries that help increase the earnings of the PVB system by reducing the PV generation sold at this injection tariff by storing for later use as self consumption. Sensitivity analysis is conducted to analyze the impact of injection tariffs.
- **Tax rebates:** The available tax rebate covers 20% of the net investment costs (i.e., investment cost minus the investment subsidy) in all Swiss cantons [63]. These tax rebates are assumed to remain constant until 2050.

Policies and regulations modeled in the Baseline scenario including tariffs and the WACC assumption are summarized in Table 4. While the investment subsidy and DSO injection tariffs are based on the current year's information (i.e. 2020), the retail and wholesale electricity prices for 2020 are assumed using the historical 2018 data from [64,65], respectively. In the Baseline scenario, consumers are assumed to have no access to the hourly wholesale market and the electricity injected back into the grid is reimbursed at the regional injection tariff. The regional injection tariff is assumed to decrease 10% per year. However, if the injection tariff in a given year and in a given region drops below the Swiss average annual wholesale price of that year, the PV injection in that region is instead paid at that average annual wholesale price. This assumption is based on the guidelines provided in the Swiss Energy Ordinance [66] that requires the remuneration to be based on the costs incurred by the grid operator for the purchase of equivalent electricity from third parties or its own production facilities. Details of the regional injection tariff can be found in Appendix C.

## 2.6. Scenarios

The profitability of PVB system investments is subject to uncertainties as the future development of PV and battery costs, injection tariffs, retail and wholesale market prices, subsidy policies etc. are unknown. Additionally, in our model, financial parameters such as WACC and amortization periods are simplified as a constant value for

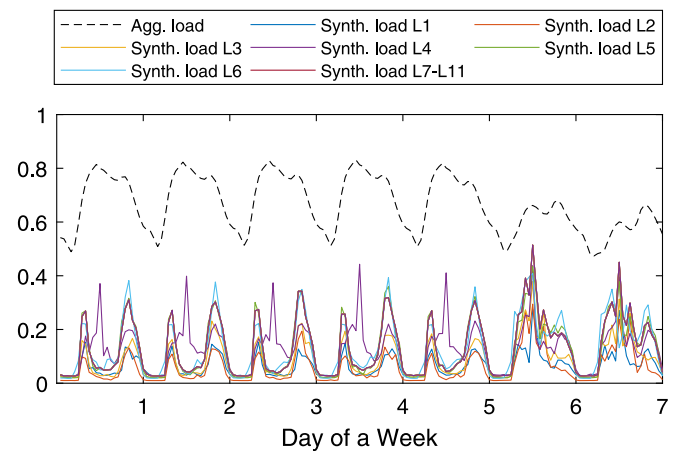


Fig. 2. Normalized aggregated load profile for canton Zurich and synthetic individual load profiles for L1-L11.

all modeled PV categories, which is likely not the case in reality.<sup>4</sup> To investigate how the profitability of PVB systems, and consequently the investment decisions, are affected by our assumptions, a set of one-at-a-time sensitivity analyses on some main parameters, such as the projections of PV and battery costs, load profiles, retail and wholesale electricity price developments, PV injection tariffs, and the WACC, is conducted. Note that the sensitivity scenarios described below are only simulated for the example of the canton of Zurich in 2050, while the Baseline scenario is simulated for 2020–2050 for all cantons.

### 2.6.1. PV and battery cost scenarios

In addition to the Baseline scenario (as introduced in Table 2), two additional cost sensitivity scenarios, namely a high cost scenario SC1, and a low cost scenario SC2 are simulated. On average, the high (low) cost scenario corresponds to 15% higher (lower) costs for the PV and 54% higher (lower) costs for the battery than the Baseline scenario. The differences among the three scenarios vary across the years. The different size categories and details of the cost projections for these three scenarios based on [42,43] can be found in Appendices A and B.

### 2.6.2. Load profile scenarios

In the Baseline scenario, the load profiles of consumption categories L1-L11 are modeled using different load profiles generated by "Load-ProfileGenerator". The work in [14] indicates that using aggregated load profiles leads to higher shares of self-consumption compared to the use of an individual profile. Fig. 2 shows the average weekly normalized aggregated load profile for the canton of Zurich in 2018 together with eleven normalized synthetic load profiles adopted for consumption categories L1-L11. Note that the aggregated load profiles consist of demand from the residential sector, the industrial and service sectors, etc., which have different load patterns. It can be seen that the individual load profiles are quite different than the aggregated profile. The individual profiles tend to peak once in the morning and once during the evening while the aggregated profile peaks just once during the day. Furthermore, the aggregated load profile follows a pattern

<sup>4</sup> In fact, different potential investors, from individual homeowners to larger industrial operators, might have different needs regarding their desired pay-back periods as well as different considerations about financing an investment in PV including the amount of debt they take on and the interest rate set by their lenders. Additionally, the constant assumptions ignore that some investors have non-economic desires, such as early adopters and innovators who might be driven by environmental issues versus laggards and late majority who might have a higher risk aversion.

**Table 4**  
Input parameters for modeled policies and regulations.

Parameter	Value	Source
Investment subsidy	909 € + 273~309 €/kW	[44]
Investment subsidy change	-2%/year	n/a
Investment subsidy expires	2030	[44]
DSO injection tariff	5.7~11.8 cent/kWh	[62]
DSO injection tariff change	up to -10%/year <sup>a</sup>	[23]
Retail el. tariff	12.3~35.4 cent/kWh	[64]
Retail el. tariff change	+1%/year	[6]
Wholesale el. tariff	0~161.4 €/MWh	[65]
Wholesale el. tariff change	+1.5%/year	[6]
Tax rebate	20% of net investment cost	[63]
WACC	4%	[6]

Note: the exchange rate is assumed to be 0.91 EUR/CHF.

<sup>a</sup>Detailed yearly development of the injection tariff also depends on the average wholesale market price assumption of the corresponding year.

**Table 5**  
Parameters of price scenarios SP1-SP9.

Scenario	Retail price change	Wholesale price change
SP1		-1%/year
SP2	+0%/year	+1.5%/year*
SP3		+3%/year
SP4		-1%/year
SP5	+1%/year*	+1.5%/year*
SP6		+3%/year
SP7		-1%/year
SP8	+2%/year	+1.5%/year*
SP9		+3%/year

Note: values that are the same as the Baseline scenario are noted with an asterisk (\*).

with lower consumption during the weekend whereas the individual customers consume more during the weekend. Such differences could result in different estimates of PV self-consumption and evaluations of the battery installations if aggregated load profiles are used instead of individual profiles. Therefore, a sensitivity scenario SL, where the synthetic load profiles of all consumption categories are replaced by the corresponding aggregated cantonal load profile, to analyze the impact of using the aggregated load profile, is simulated.

### 2.6.3. Electricity price scenarios

In the Baseline scenario, it is assumed that the retail electricity price increases by 1% per year and the prosumers have no access to the hourly wholesale market. All excess generation injected back into the grid is reimbursed by the regional injection tariff. The regional injection tariff is assumed to decrease 10% per year until it reaches the corresponding yearly average Swiss wholesale electricity price, which is assumed to increase by 1.5% per year. In all years afterwards, the regional injection tariff is instead set equal to the yearly average Swiss wholesale price (see Appendix C for details of the regional injection tariff).

However, it is highly uncertain how the injection tariffs as well as the retail and wholesale electricity prices evolve in future years and it is also unclear to what extent small prosumers will have access to the wholesale market. To analyze the impact of replacing the injection tariff with the wholesale market price (i.e., simulate the case when end consumers have access to the wholesale market), nine electricity price sensitivity scenarios SP1–SP9 detailed in Table 5 are simulated similar to the electricity price scenarios modeled in [6]. One other sensitivity scenario (i.e. SP10) is simulated to analyze the extreme case of having an injection tariff equal to zero and no access to the hourly wholesale market while the retail prices increase by 1% per year (same as the Baseline scenario).

### 2.6.4. Battery scenario

In the Baseline scenario, the battery costs are set based on [43], which projects the development of the battery costs using a number of international reports.

Since the battery costs (especially the labor cost) in Switzerland are generally higher than the global average, a sensitivity scenario (i.e., SB1) is created in which the battery investment cost assumption for 2020 is adjusted using the current Tesla Powerwall 2 price in Switzerland (i.e. 14'700 CHF equivalent to 13'364 EUR accounting for the total costs incurred for installing a 13.5 kWh Tesla Powerwall 2), while the cost reduction rate over the years remains the same as the Baseline scenario. Furthermore, a sensitivity scenario without any batteries (i.e., SB2) is also simulated to analyze the financial benefit of installing batteries.

### 2.6.5. WACC scenarios

Cost of capital is defined as the expected rate of return that market participants require in order to attract funds for a particular investment [67]. In the Baseline scenario, a 4% WACC is assumed for all PVB system investments.

The value of WACC varies over time and between different technologies, e.g. smaller PVB systems are mainly invested by households, who face lower WACC than investors of larger-sized PVB systems. Therefore, two sensitivity scenarios assuming a 2% (i.e. SW1) and a 8% (i.e. SW2) WACC are simulated to compare against the Baseline assumption.

Table 6 summarizes the main parameter changes of the different sensitivity scenarios compared to the Baseline scenario.

## 3. Method

In this section, the mathematical formulation of the optimization problem is first described, followed by the definitions of the technical and economic indicators used for evaluating the investment decisions.

In this work, the investment decisions are optimized using a static investment model and the investment will be made for any simulation year when it is economically viable. In contrast, the time to invest is not optimized and the option to postpone the investment to yield a higher net present value is not considered. More specifically, for each region and each examined year the optimization is carried out considering a 30-year lifetime of the PVB system. The simulation optimizes the investment decisions over the full 30-year lifetime by optimizing the operational decisions for all 8760 h of the examined year and assuming identical operations along with projections for other parameters (e.g., wholesale price and injection tariff) over the remaining lifetime of the PVB system, i.e. 29 years. The model formulation, described below, is applied to each region, hence the region index is omitted in the following equations for simplification. To optimize the investment and operational decisions, three groups of constraints are considered: (1) investment constraints, (2) operational constraints and (3) system



**Table 6**  
Summary of the sensitivity scenarios.

Scenario name	Changed parameters	Remarks
SC1-2	PV and battery costs	A high cost (SC1) and a low cost scenario (SC2)
SL	Load profile	Individual load profiles replaced by the aggregate profile
SP1-9	Retail and wholesale el. price development	Access to wholesale market; injection tariff replaced by hourly wholesale price
SP10	Retail el. price development; injection tariff	No access to wholesale market; injection tariff is zero
SB1-2	Battery price; battery investment	Battery price adjusted using current Tesla price in Switzerland (SB1); battery forced not to be installed (SB2)
SW1-2	WACC	A 2% WACC (SW1) and a 8% WACC scenario (SW2)

power balance constraints. The objective is to minimize the total investment and operating costs of the PVB system, which consists of the PV unit, the battery unit and the load, over the 30-year simulation horizon. Details of the objective function are given after the constraints are described.

### 3.1. Investment constraints

Each rooftop in each region  $reg \in REG$  is categorized by which customer group  $c$  it fits into, defined by the combination of irradiation category  $i \in I$ , electricity consumption category  $j \in J$ , and roof size category  $k \in K$  (i.e., for each region this is 1 out of 2200 possible customer groups). In other words, the customer group set  $C$  with  $c \in C$  includes all combinations of irradiation, electricity consumption and roof size categories, i.e.  $C = \{(i, j, k) : i \in I, j \in J, k \in K\}$ . Each combination  $(i, j, k)$  is represented by a specific customer group  $c$ .

As mentioned, five PV candidate units corresponding to five size categories (i.e., 0–6 kWp, 6–10 kWp, 10–30 kWp, 30–100 kWp, >100 kWp) are considered in this work. Let  $P$  denote the set of all these five candidate PV categories. For each customer group  $c$ , the sum of the installed capacity  $cap_{p,c}^{pv}$  over all PV categories  $p \in P$  is non-negative and limited by the maximum deployment potential  $dep_c^{pv,max}$ , which is equal to the corresponding available rooftop area of the customer group divided by the rooftop area required for 1 kWp of PV (i.e. 6m<sup>2</sup>/kWp, provided in Table 2). Consequently,

$$0 \leq \sum_p cap_{p,c}^{pv} \leq dep_c^{pv,max} \quad (1)$$

The installed capacity  $cap_{p,c}^{pv}$  of each PV category should be greater or equal to the minimum size requirement of that category  $cap_p^{pv,min}$ , i.e.,

$$cap_{p,c}^{pv} = u_{p,c}^{pv} x_{p,c}^{pv} \quad (2)$$

$$cap_{p,c}^{pv} \geq u_{p,c}^{pv} cap_p^{pv,min} \quad (3)$$

where  $u^{pv}$  is a binary variable that indicates whether the PV unit is invested or not and  $x^{pv}$  is the continuous investment capacity variable. All investment decisions are non-negative:

$$cap_{p,c}^{pv}, cap_c^{bat-e}, cap_c^{bat-p} \geq 0 \quad (4)$$

where  $cap_c^{bat-e}$  and  $cap_c^{bat-p}$  are the invested energy and power capacity of the PV-battery unit, respectively. Note that the battery C-rate is not fixed and is decided by the invested energy and power capacity of the battery.

### 3.2. Operational constraints

The PV generation output  $gen_{i,p,c}^{pv}$  of PV unit  $p$  and customer group  $c$  at time  $t$  is limited by the invested module area  $A^{pv}$  multiplied by the module efficiency  $\eta^{pv-mod}$ , inverter efficiency  $\eta^{inv}$ , performance ratio  $\eta^{pv-pf}$  and the solar irradiation  $I^{pv}$  at time  $t$ , i.e.,

$$0 \leq gen_{i,p,c}^{pv} \leq A_{p,c}^{pv} \eta_p^{pv-mod} \eta_p^{inv} \eta_p^{pv-pf} I_{t,c}^{pv} \quad (5)$$

$$A_{p,c}^{pv} = cap_{p,c}^{pv} a_p^{pv} \quad (6)$$

where  $a_p^{pv}$  is the rooftop area required by each kWp of the installed PV. The inequality in constraint (5) allows the possibility of PV curtailment.

The PV-battery has no direct connection to the grid and, in general, it charges (discharges) when the demand of the customer is lower (higher) than the PV generation. The stored energy of the PV-battery unit  $E^{bat}$  is limited by its maximum DOD indicated by  $DOD^{max}$  and the installed energy capacity  $cap^{bat-e}$ :

$$(1 - DOD^{max}) cap_c^{bat-e} \leq E_{t,c}^{bat} \leq cap_c^{bat-e} \quad (7)$$

The PV-battery inflow  $p^{ch}$  and outflow  $p^{dis}$  are non-negative and limited by the installed power capacity of the battery  $cap^{bat-p}$ . Mathematically,

$$0 \leq p_{t,c}^{ch} \leq cap_c^{bat-p} \quad (8)$$

$$0 \leq p_{t,c}^{dis} \leq cap_c^{bat-p} \quad (9)$$

Finally, the relationship of the storage level  $E^{bat}$  at the end of each time step across two consecutive time steps is defined by:

$$E_{t,c}^{bat} = E_{t-1,c}^{bat} + \eta^{bat,c} p_{t,c}^{ch} \Delta t - p_{t,c}^{dis} \Delta t / (\eta^{bat,d} \eta^{bat,inv}) \quad (10)$$

where  $\eta^{bat,c}$  and  $\eta^{bat,d}$  are the charging and discharging efficiencies of the battery, The battery inverter efficiency is denoted as  $\eta^{bat,inv}$  and  $\Delta t$  is the length of one time step.

### 3.3. Power balance constraints

As shown in Fig. 1, the power from the PV units could be used to (1) charge the battery with  $p^{pv2bat}$ , (2) supply (at least part of) the demand with  $p^{pv2l}$  or (3) be injected into the grid with  $p^{pv2g}$ . Note that each customer group  $c$  has the choice to invest in any category and any number of PV panels as long as the corresponding rooftop size allows. At each time step, the sum of the power outflows of all PV units installed by customer group  $c$  should not be greater than the total PV generation:

$$p_{t,c}^{pv2bat} + p_{t,c}^{pv2l} + p_{t,c}^{pv2g} \leq \sum_p gen_{i,p,c}^{pv} \quad (11)$$

$$p_{t,c}^{pv2g}, p_{t,c}^{pv2l} \geq 0 \quad (12)$$

$$p_{t,c}^{pv2bat} = p_{t,c}^{ch} \quad (13)$$

Similarly, at each time step, the demand  $l$  can be satisfied by: (1) power from PV to the load  $p^{pv2l}$ , (2) power from the battery to the load  $p^{bat2l}$  or (3) power from the grid to the load  $p^{g2l}$ . Mathematically,

$$p_{t,c}^{pv2l} + p_{t,c}^{bat2l} + p_{t,c}^{g2l} \geq l_{t,c} \quad (14)$$

$$p_{t,c}^{bat2l}, p_{t,c}^{g2l} \geq 0 \quad (15)$$

$$p_{t,c}^{bat2l} = p_{t,c}^{dis} \quad (16)$$

The self-consumed portion of the PV generation  $p^{sc}$  is defined as the total PV electricity output that is directly or indirectly consumed by the customer [68], which corresponds to the power from PV to load and from battery to load, respectively, i.e.

$$p_{t,c}^{sc} = p_{t,c}^{pv2l} + p_{t,c}^{bat2l} \quad (17)$$

### 3.4. Formulation of optimization problem

The objective is to optimize the investment and operational decisions of the PVB system while minimizing the cost. The cost can be assessed using the discounted cash flow method, which calculates the net present value (NPV) of the investment as the sum of investment costs and all discounted future cash flows.

The total investment cost comprises the net PV investment cost  $C_c^{inv,pv}$  and the battery investment cost  $C_c^{inv,bat}$ . The PV portion accounts for the investment subsidy  $r^{sub,pv}$  and the tax rebate  $r^{tax,pv}$  per kWp. The investment costs across the five PV categories is then given by

$$C_c^{inv,pv} = \sum_p (1 - r^{tax,pv}) (c_p^{inv,pv} - r_p^{sub,pv}) cap_{p,c}^{pv} \quad (18)$$

where  $c^{inv,pv}$  is the cost of PV per kWp for category  $p$ . The battery portion considers both the energy-related  $c^{inv,bat-e}$  and the power-related  $c^{inv,bat-p}$  investment costs, namely

$$C_c^{inv,bat} = c^{inv,bat-e} cap_c^{bat-e} + c^{inv,bat-p} cap_c^{bat-p} \quad (19)$$

Future annual costs  $C_{y,c}^{out}$  in year  $y$  include both variable and fixed operational and maintenance costs of the PVB system, i.e.,

$$C_{y,c}^{out} = \sum_t (\sum_p c_p^{voc,pv} gen_{t,p,c}^{pv} + c^{voc,bat-e} p_{t,c}^{dis}) + c^{foc,bat-p} cap_c^{bat-p} \quad (20)$$

where  $c^{voc,pv}$ ,  $c^{voc,bat-e}$  and  $c^{foc,bat-p}$  are the variable cost parameter of PV, along with the energy-related and the power-related cost parameters of the PV-battery.

The annual revenues  $R^{in}$  include incomes from reimbursement of injecting electricity to the grid and savings from self consumption. To account for the degradation of the system, the annual revenues are multiplied by the annual system degradation rate  $\delta^{deg}$  to the power of  $y - y_0$ , which is the difference between the considered year  $y$  and the investment year of the PVB system  $y_0$ . This results in the following equation:

$$R_{y,c}^{in} = \sum_t (p_{t,c}^{p2g} pr_{y,t,c}^{inj} + p_{t,c}^{sc} pr_{y,t,c}^{retail}) (1 - \delta^{deg})^{y-y_0} \quad (21)$$

where  $pr^{inj}$  and  $pr^{retail}$  are the injection tariff and the retail electricity tariff. The savings from the self-consumed portion of the PV generation in the model is calculated as the product of the self-consumed electricity and the retail electricity tariff, which better reflects the consumers' savings and economic trade-offs. The retail electricity tariff is modeled using a dual tariff system with varying high and low tariffs depending on the corresponding annual electricity consumption category. Details of the retail electricity tariffs for the considered consumption categories L1-L11 are provided in [Appendix D](#).

Furthermore, since the lifetime of the battery unit (i.e., 13 years) is shorter than that of the PVB system (i.e., 30 years), a replacement of the battery unit and the possible residual value of the new battery unit at the end of the PVB system needs to be accounted for. The replacement cost  $C_{y',c}^{rpl,bat}$  in the year of replacement  $y'$  is calculated using the investment cost in that year (i.e.,  $c_{y'}^{inv,bat-e}$  and  $c_{y'}^{inv,bat-p}$ ), while the reinvested power and energy capacity of the battery is assumed to be the same as for the initial battery, i.e.

$$C_{y',c}^{rpl,bat} = c_{y'}^{inv,bat-e} cap_c^{bat-e} + c_{y'}^{inv,bat-p} cap_c^{bat-p} \quad (22)$$

$$y' = l^{bat} n' + 1, \quad (23)$$

$$n' \in \{n' : n' \in \mathbb{Z}, 1 \leq n' \leq [(l^{sys} - 1)/l^{bat}]\}$$

where  $l^{sys}$  and  $l^{bat}$  are the lifetimes of the PVB system and the battery. The number of needed battery replacements is calculated as  $[(l^{sys} - 1)/l^{bat}]$ .

The residual value of the last reinvested battery  $C_c^{res}$  is calculated as the multiplication of the annuity factor  $\gamma^{ann}$ , with the corresponding replacement cost and the residual battery lifetime by the end of the PVB system calculated as  $l^{bat-res}$ :

$$R_c^{res,bat} = \gamma^{ann} l^{bat-res} C_{y'=l^{bat}[(l^{sys}-1)/l^{bat}]+1,c}^{rpl,bat} \quad (24)$$

$$\gamma^{ann} = \frac{wacc}{1 - 1/(1 + wacc)^{l^{bat}}} \quad (25)$$

$$l^{bat-res} = [l^{bat}[(l^{sys} - 1)/l^{bat}] + 1] - l^{sys} \quad (26)$$

where the year when the last required battery replacement takes place is  $l^{bat}[(l^{sys} - 1)/l^{bat}] + 1$ . For example, if battery lifetime (i.e.,  $l^{bat}$ ) is 13 years and the PVB system lifetime (i.e.,  $l^{sys}$ ) is 30 years, then the number of needed battery replacements is calculated as two (i.e.,  $[(l^{sys} - 1)/l^{bat}]$ ) and the year of the last required battery replacement is the 27th year (i.e.,  $l^{bat}[(l^{sys} - 1)/l^{bat}] + 1$ ) starting from the investment year.

Finally, the optimization problem for the entire lifetime of the PVB system can be formulated as

$$\begin{aligned} \min \quad & \sum_c [C_c^{inv,pv} + C_c^{inv,bat} + \sum_{y=y_0}^{l^{sys}} \frac{C_{y,c}^{out} - R_{y,c}^{in}}{(1 + wacc)^y} \\ & + \sum_{n'=1}^{[(l^{sys}-1)/l^{bat}]} C_{y'=l^{bat}n'+1,c}^{rpl,bat} - R_c^{res,bat}] \end{aligned}$$

s.t. Constraints (1)–(26)

where all future revenues and costs are discounted by WACC to convert to the NPV.

### 3.5. Technical and economic indicators

Technical indicators for self-consumption rate and self-sufficiency rate as well as an economic indicator for payback period that will be used in the following analysis are described as follows:

#### 3.5.1. Self-consumption rate

Based on definitions given in [68], the self-consumption rate (SCR) is equal to the total PV electricity output that is directly or indirectly consumed by the PVB system owner divided by the total PV generation.

#### 3.5.2. Self-sufficiency rate

The self-sufficiency rate (SSR) represents the ratio of the electricity demand that can be satisfied by the PVB system over the total electricity consumption of the PVB system owner [68].

#### 3.5.3. Payback period

The payback period (PBP) used in this paper is defined as the investment cost divided by the yearly cash flow, i.e. corresponds to the simple payback. In contrast to the discounted PBP, the simple PBP does not account for the time value of money. The shorter the PBP is, the more attractive the investment is.

#### 3.5.4. Levelized cost of electricity

The levelized cost of electricity (LCOE) of the PV unit (i.e.,  $LCOE_{pv}$ ) and the PVB system (i.e.,  $LCOE_{pnb}$ ) is calculated using the “discounting” method, i.e., LCOE is equal to the ratio of the discounted total lifetime cost to the lifetime generation output in [Box I](#).

It is worth noting that various forms of LCOE metrics especially for hybrid systems have been developed recently [69–71], and the results might not be compared in a straightforward way as they embody different assumptions (e.g., tax rebates, subsidies and discount rates) and the LCOE formulas could be different as well. Although the LCOE value is useful for comparing the results of different works, the readers are suggested to be cautious when using these values.

$$\text{LCOE}_{\text{pv}} = \frac{\text{PV investment cost} - \text{subsidy} + \text{discounted lifetime O\&M cost}}{\text{lifetime PV generation considering degradation}}$$

$$\text{LCOE}_{\text{pvb}} = \frac{\text{investment cost} - \text{subsidy} + \text{battery replacement cost} - \text{battery residual value} + \text{discounted lifetime O\&M cost}}{\text{lifetime PV generation considering degradation and battery charging/discharging losses}}$$

Box 1.

## 4. Results

In the Baseline scenario, the model is executed for each region and each customer group considering possible investments between 2020–2050 using a 5-year time step. More specifically, the static investment model is simulated for each investment year without considering any investments in previous years (i.e., a greenfield investment is simulated and the potentials for deployment are the same for each investment year). Investment decisions are optimized by minimizing all investment and operating costs over a 30-year lifetime assumed for the PVB system, where the operational decisions over all 8760 h of the examined year are simulated and are assumed to be the same for the years of the remaining lifetime of the PVB system. Different from the dynamic multi-period investment model that also optimizes investment timing and provides investment pathways, this work mainly aims to answer the question of how the economic viability of the PVB system changes over time, i.e. for different investment years and its relation to the characteristics of different customer groups. Each sensitivity scenario is only simulated for one example region (i.e., canton of Zurich) for the investment year 2050.

To better explain the results, in this section, the results of an example customer group in Section 4.1 are shown first, then the results for the example of the canton of Zurich are illustrated in Section 4.2. Finally, the results at the national level (i.e., Switzerland) are analyzed in Section 4.3. For the first two subsections (i.e., Section 4.1 and Section 4.2), the Baseline results are presented first, followed by the results of the sensitivity analyses.

### 4.1. Results for one representative customer group

The average annual electricity consumption per household in Switzerland is 5000 kWh [72] and the average annual solar irradiance in Switzerland is 1267 kWh/m<sup>2</sup> [73]. To represent an average customer group in Switzerland, the group with the following criteria is selected: canton of Zurich (REG1), rooftop size of 108–120 m<sup>2</sup> (A13), annual irradiation of 1150–1300 kWh/m<sup>2</sup>/year (IRR2) and electricity consumption of 4500–5500 kWh/year (L5). As mentioned in Section 2.2, each customer group is represented using the median values of the rooftop size, the annual irradiation and the electricity consumption from within the group. Since a range of rooftop sizes in a particular customer group are analyzed together using representative characteristics, the investment decision for each group yields a single combination of PV and battery investments for all rooftops within this group. For example, the selected customer group has a median annual electricity consumption of 5025 kWh, a median annual solar irradiation of 1212 kWh/m<sup>2</sup> and a median rooftop size of 113 m<sup>2</sup> (i.e., equivalent to 18.8 kWp potential of PV). The aggregated rooftop area within the considered customer group is equal to 20'751 m<sup>2</sup>, which means the optimized decision for the representative customer is reflective of around 184 customers (i.e., total rooftop size divided by the median rooftop size of the customer group). Note that the results shown in this section are only for the single representative rooftop within the single selected customer group.

#### 4.1.1. Baseline results - investment

Table 7 shows the optimal investment decisions of the example customer group over the simulation horizon (i.e. 2020–2050) for the Baseline scenario. Comparing the results over the years, the optimal PV and battery sizes for the representative rooftop in this customer group continue to increase. The PBP in general follows a decreasing trend from above 13 years in 2025 to below 10 years in 2050 except for an increase from 2030 to 2035, which is mainly due to the subsidy expiration by the end of 2030. Correspondingly, the NPV in general increases over time except a slight decrease from 2030 to 2035. Changes to these optimal investment decisions and the resulting PBP and NPV over the years can be mainly traced back to the decreasing PV and battery costs and the increasing retail electricity tariffs. The PVB C-rate is fairly consistent over the years between 0.19–0.23, which is reasonable considering the popular household consumer solar battery systems available nowadays (e.g. the 13.5 kWh/3.6 kW Tesla Powerwall2 with a C-rate of 0.27 [74] and the 15 kWh/3.3 kW Sonnenbatterie Eco9 with a C-rate of 0.22 [75]). Furthermore, the SSR increases with the increasing size of the PVB system, meaning that the homeowner is able to supply more and more of its own demand. In contrast, the SCR first increases and then decreases, indicating that the larger PVB systems tend to sell a larger portion of their production to the grid. This result also shows that the investment profitability in early years is driven by the high SCR while further into the future it is instead driven by the decreasing costs. In these future years, it is also profitable to install a PVB system that is larger than required for the consumers' demand. When comparing the LCOE values over the years, it can be observed that the LCOE is mainly influenced by the investment subsidy and the investment capacity. Although investing in battery units increases the LCOE value, whether investing in battery or not also depends on if the additional revenues brought by battery installations exceed the costs. Note that the readers need to be cautious when comparing the LCOE values to other works as they are calculated under various assumptions and using different formulas. For example, some LCOE formulas using discounted electricity generation as the denominator of the LCOE metric, whereas others (e.g. the one applied in this paper) do not discount the electricity generation over time.


#### 4.1.2. Baseline results - dispatch

Fig. 3 shows the generation and load dispatch of the PVB system of an example winter and summer week for 2030 and 2050, respectively. Both the selected winter and summer weeks start from a Monday. Low electricity tariff hours (i.e., off-peak hours) are marked by the gray area, while the rest is the high electricity tariff period.

In general, the battery discharges/charges when the load is higher/lower than the PV generation to increase the self-consumption rate and in turn improve the profitability of the PVB system investment. An exception can be observed on the 7th day (i.e., Sunday) of the winter weeks, when the battery charges even though the load is higher than the PV generation. This is due to the assumption that all hours on Sunday are low electricity tariff hours (i.e., off-peak). The PVB system therefore takes advantage of the cheap electricity from the grid to supply the demand while the PV-battery absorbs the PV generation for later use during high electricity tariff hours. Furthermore, discharging is ideally done during the peak electricity tariff hours (i.e., 6:00–22:00 from Monday to Saturday) in order to reduce the electricity

**Table 7**  
Baseline analysis for the representative rooftop of the example customer group.

Year	Investment size [kW or kWh]			NPV [kEUR]	PBP [Year]	SCR	SSR	LCOE [cent/kWh]	
	PV	BESS-e /BESS-p	BESS C-rate					PV alone	PVB system
2020	0	0/0	n/a	n/a	n/a	n/a	n/a	n/a	n/a
2025	2.0	3.0/0.6	0.20	0.5	13.5	74%	29%	6.22	8.41
2030	2.3	5.7/1.0	0.19	1.4	11.8	80%	36%	5.79	8.30
2035	2.7	7.2/1.4	0.20	1.3	13.0	80%	42%	6.94	9.24
2040	3.3	8.6/1.8	0.21	2.3	11.7	77%	48%	6.42	8.51
2045	6.0	10.0/2.3	0.23	3.4	11.4	56%	64%	5.26	6.49
2050	6.0	10.3/2.3	0.22	5.1	9.5	56%	65%	4.67	5.86

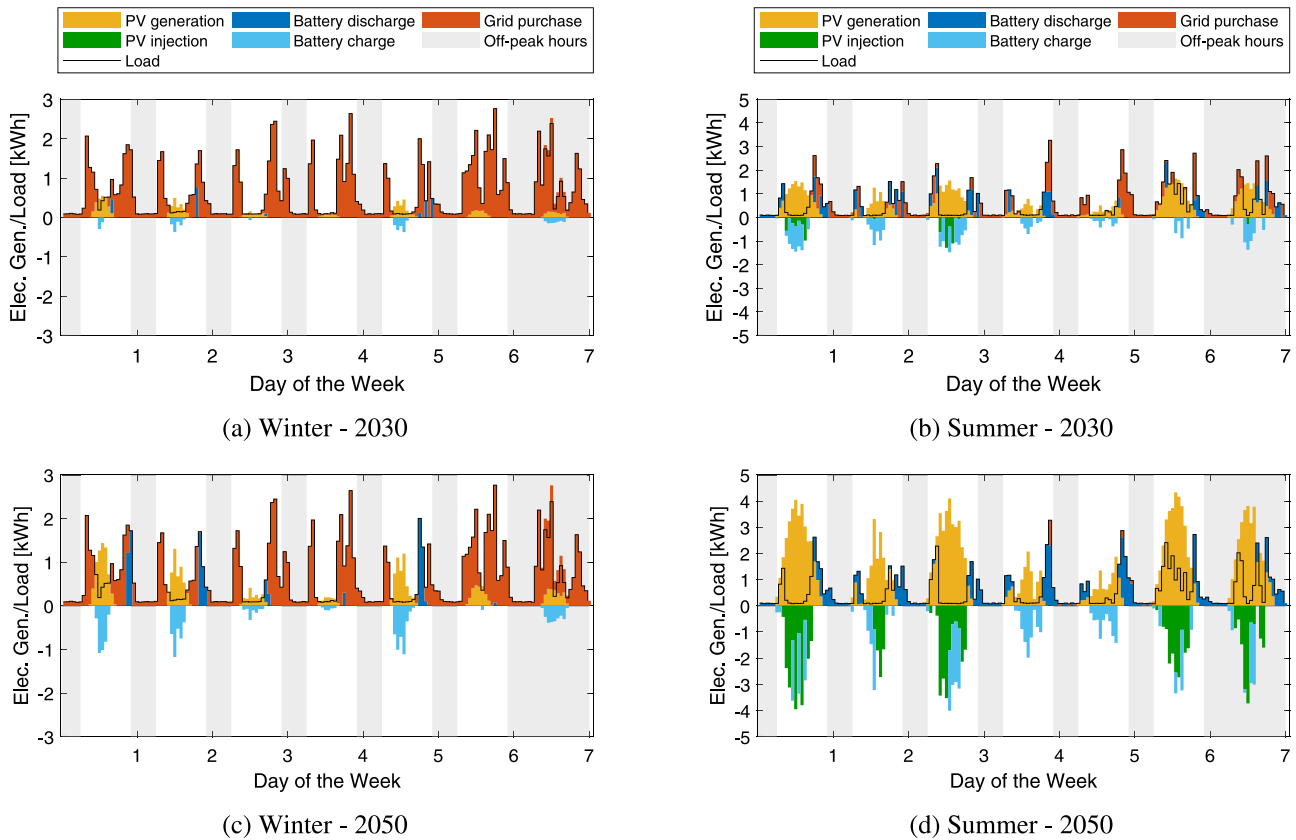

**Fig. 3.** Dispatch of the PVB system for the representative rooftop of the example customer group in 2030 and 2050.

bill. Note that in the Baseline scenario, the retail electricity tariffs are modeled using a dual system while the injection tariff is assumed to be constant over all hours. Hence, non-unique solutions might occur as the charging/discharging in different hours in the same price tier could result in the same objective value. However, this is irrelevant for our study.

As shown in Table 7, the optimal invested battery size increases from 5.7 kWh/1.0 kW in 2030 to 10.3 kWh/2.3 kW in 2050, whereas the optimal PV size increases from 2.3 kW to 6.0 kW between the same years. Comparing the 2050 dispatch results to that of 2030 both shown in Fig. 3, the grid purchases decrease while the PV injections increase due to the larger size of the installed PV system. Although the battery size is also expanded, the general pattern of the PVB system behavior does not change significantly. Additionally, the dynamics of the power consumed/sold to the grid are exacerbated since in 2050 the installed battery capacity per kW of PV is lower.

#### 4.1.3. Sensitivity scenario results

The results of simulating different sensitivity scenarios in 2050 are provided in Table 8. The main observations are:

- **Cost sensitivity:** The optimal battery size and the NPV decreases/increases, and the PBP increases/decreases in the high/low cost scenario (i.e., SC1/SC2), while the optimal PV size is unchanged. This is due to the fact that the future battery cost is subject to higher uncertainties than that of PV.
- **Load sensitivity:** When applying the aggregate load profile (i.e. SL) with equal energy consumed, the optimal PV size stays unchanged, but both the optimal battery size and battery C-rate are reduced. This is because the aggregate load profile is flatter and better matches the PV generation profile than the individual load profiles, therefore a smaller battery is required to achieve similar SCR and SSR values to those of the Baseline scenario, which results in a higher NPV and a shorter PBP.
- **Price sensitivity I:** Having access to the hourly wholesale market (i.e. SP1-SP9) has mixed impacts on the investment decisions, the NPV and the PBP, depending on how the retail and wholesale electricity prices evolve.

Comparing the results under the same retail electricity price (i.e., SP1 vs. SP2 vs. SP3; SP4 vs. SP5 vs. SP6; SP7 vs. SP8 vs. SP9), higher wholesale market prices increase the optimal PV investment size and the NPV, and reduce the SCR since it means



**Table 8**  
Sensitivity analysis for the representative rooftop of the example customer group in 2050.

Year	Investment size [kW or kWh]			NPV [kEUR]	PBP [Year]	SCR	SSR
	PV	BESS-e /BESS-p	BESS C-rate				
Base.	6.0	10.3/2.3	0.22	5.1	9.5	56%	65%
SC1	6.0	8.6/1.9	0.23	3.2	11.8	55%	63%
SC2	6.0	14.4/2.7	0.19	7.2	7.0	57%	67%
SL	6.0	7.1/1.4	0.20	5.4	8.9	57%	65%
SP1	2.1	5.6/1.1	0.19	0.6	14.7	82%	34%
SP2	6.0	8.6/2.1	0.24	1.0	14.8	54%	63%
SP3	6.0	7.9/2.0	0.25	2.0	12.9	54%	62%
SP4	6.0	10.5/2.4	0.22	4.7	9.9	56%	65%
SP5	6.0	10.3/2.4	0.23	5.4	9.3	56%	65%
SP6	10.0	10.6/2.6	0.24	7.0	9.6	39%	75%
SP7	6.0	11.8/2.6	0.22	11.6	6.2	57%	66%
SP8	10.0	12.5/2.8	0.22	12.6	7.2	39%	76%
SP9	12.3	12.2/3.0	0.24	15.1	7.2	34%	79%
SP10	6.0	10.6/2.4	0.22	4.3	10.2	56%	65%
SW1	6.0	10.5/2.3	0.22	8.3	9.8	56%	65%
SW2	6.0	10.5/2.3	0.22	1.6	8.7	56%	65%
SB1	6.0	7.6/1.8	0.23	3.7	11.0	53%	62%
SB2	2.0	n/a	n/a	0.9	11.9	49%	19%

greater revenues for the same amount of electricity injection. However, higher wholesale prices in general reduce the optimal battery (energy and power) capacity invested per unit installed PV capacity. This is because the spread between wholesale and retail electricity prices is smaller when higher wholesale electricity is simulated, which lowers the savings earned by using batteries. Interestingly, the battery C-rate increases with the increasing wholesale price development (i.e., from SP1 to SP3, from SP4 to SP6 and from SP7 to SP9) since higher wholesale prices encourage investments in a larger PV unit, which in turn requires a higher C-rate to cope with the increased dynamics of the net load.

Comparing the results under the same wholesale electricity price (i.e., SP1 vs. SP4 vs. SP7; SP2 vs. SP5 vs. SP8; SP3 vs. SP6 vs. SP9), the higher retail electricity prices (i.e., SP7-SP9) reduce the PBP and increase the NPV and the optimal size of both PV and battery units.

The impact of the wholesale electricity price is limited compared to the influence of the retail electricity tariff as in general the retail electricity price level is higher than the wholesale electricity price.

- **Price sensitivity II:** When the injection tariff is zero and no wholesale market access is granted (i.e. SP10), the optimal PV size is the same but the battery size is slightly higher. The resulting NPV decreases and the PBP increases slightly compared to the Baseline scenario, which shows the limited impact of injection tariffs in 2050 for the example of the considered customer group.
- **WACC sensitivity:** Increasing the value of the WACC from 4% (i.e., Baseline) to 8% (i.e., SW1) or reducing it to 2% (i.e., SW2) does not impact the invested PV and battery sizes and only slightly changes the PBP. However, the NPV varies significantly under different assumptions of WACC because of the discounting factor of future cash flows.
- **Battery price sensitivity:** Adjusting the battery price using the current Tesla Powerwall 2 cost in Switzerland (i.e., SB1) results in even less battery investments than the high cost scenario SC1, which highlights the importance of considering regional differences of the PVB system investment costs.
- **Battery integration sensitivity:** When no battery installation is considered (i.e., SB2), the NPV is much lower and the PBP is longer than in the Baseline scenario, which shows that the successful combination of battery units with PV does contribute to increasing the profitability of the PVB system for the example customer group in 2050.

The NPV and the PBP are subject to future uncertainties and vary greatly between different sensitivity simulation scenarios. The economic viability of the PVB system is especially sensitive to the future cost of PV and battery and the electricity price development.

#### 4.2. Results for all customer groups within the canton of Zurich

To broaden the scope of the results, this subsection discusses the resulting optimal investment decisions for all 2200 customer groups in the canton of Zurich. The combination of these customer groups represents 435'815 individual consumers/households and a combined rooftop space of 28.4 km<sup>2</sup>, which is equivalent to a cumulative PV potential of 4.7 GW.

##### 4.2.1. Baseline results

Table 9 shows the weighted average size, NPV, PBP and LCOE as well as the cumulative capacity of the PVB investments across all customer groups in the canton of Zurich. The assigned weights are the number of customers (i.e., rooftops) in each customer group. Different from the results of the example customer group, it is profitable to invest in PV and PV-battery for some customer groups already in the current year (i.e., 2020) in Zurich. Moving from 2020 to 2050, the weighted average size of the invested PV and battery units is increasing, mainly as a result of the decreasing costs. This result is consistent with the observation drawn from the previous results of the example customer group. This growth is prominent for the battery during the period between 2020 and 2035, when the estimated battery price drops significantly (for more details see Appendix B). Although the NPV increases over the years, the weighted average PBP fluctuates between 2020 and 2035 and decreases afterwards, which is due to the mixed impacts of the investment subsidy decrease, the injection tariff variation, the retail tariff increase and the investment cost decrease. In other words, the annual net cash inflow does not increase as much as the investment cost during this period (i.e., 2020–2035). Individual impacts of some of these important input factors will be further investigated later using sensitivity analysis. Similar to the trend of the weighted average investment capacity, the cumulative PV and battery investment capacities also increase over time from 1.4 GW and 0.4 GWh/0.1 GW in 2020 to 3.6 GW and 7.7 GWh/1.6 GW in 2050, while the total PV deployment potential modeled for the canton of Zurich is 4.7 GW. It is worth noting that the resulting investment capacities account for all investments that could achieve positive NPVs, even if small, over the 30-year lifetime of the PVB system, while in reality investors might have higher expectations for the NPV and PBP.

Fig. 4 shows the cumulative PV investments in different size categories from 2020 to 2050 for the canton of Zurich. Please note by



**Table 9**  
Baseline result analysis for canton Zurich, years 2020–2050.

Year	WAVG investment size [kW or kWh]			WAVG NPV [kEUR]	WAVG PBP [Year]	Cum. PV [GW]	Cum. BESS [GWh/ GW]	WAVG LCOE [cent/kWh]	
	PV	BESS-e /BESS-p	BESS C-rate					PV alone	PVB system
2020	4.5	1.1/0.3	0.25	2.3	11.5	1.4	0.4/0.1	6.71	7.04
2025	5.8	7.0/1.5	0.21	3.3	11.7	2.2	2.7/0.6	6.13	7.64
2030	7.6	14.0/2.8	0.20	6.0	11.0	3.0	5.4/1.1	5.64	7.54
2035	7.8	16.7/3.4	0.20	6.5	11.6	3.0	6.4/1.3	6.46	8.31
2040	8.3	18.1/3.7	0.20	8.9	10.2	3.2	7.0/1.4	5.91	7.61
2045	8.8	18.9/3.9	0.20	10.9	9.3	3.4	7.3/1.5	5.53	7.11
2050	9.2	19.8/4.0	0.20	13.3	8.3	3.6	7.7/1.6	5.16	6.61

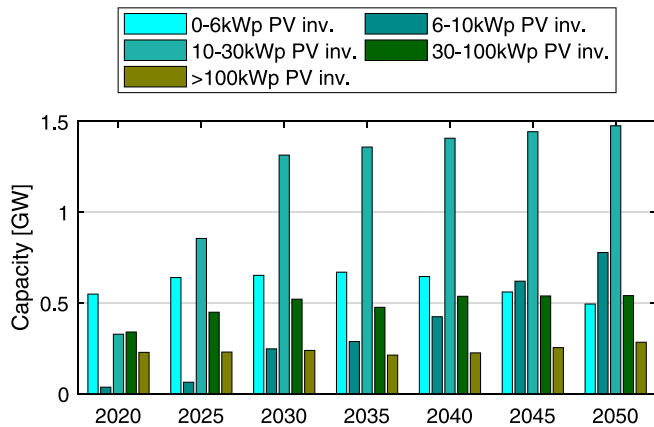


Fig. 4. Cumulative PV investments in different size categories for the canton of Zurich, years 2020–2050.

cumulative, it is referred to the summation over all customer groups in any particular year and not over time as the simulation starts with a greenfield in every considered year. While the cumulative investments in 6–10 kW and 10–30 kW PV units increase significantly from 2020 to 2050, investments in other PV size categories fluctuate over the years: (a) investments in PV sizes below 6 kW first increase then decrease, which is likely due to the fact that investments are driven by high SCR in early years and most customer groups install smaller PV units that do not fully exploit the potential of their rooftop sizes.<sup>5</sup> Since the optimal PV size increases mainly as a result of the decreasing investment cost, the cumulative PV investment capacity gradually shifts from smaller to greater PV size categories; (b) investments in PV above 30 kW in general increase over time except for a small decrease between 2030 and 2035, which shows that compared to that of smaller PV units the economic viability of larger PV units relies more on the investment subsidy.

Fig. 5 depicts the relationship between the total optimal PV and battery investment capacities and the PBP over all 2200 customer groups. In all three plots, each line represents the accumulated capacity of the 2200 customer groups, which have been ordered by increasing PBPs. In general, the total capacities of the invested PV and battery units increase over the years, along with yielding more capacities that have shorter PBP. However, the curves of 2030 and 2035 (especially for the PV investment capacity) intersect/overlap, which is, as elaborated already also earlier, mainly because of the mixed effects of cost reductions and the investment subsidy expiration by the end of 2030.

<sup>5</sup> Assuming the considered available rooftop potential in the canton of Zurich is fully exploited (i.e., PV units sizes are maximized for every single house based solely on the corresponding rooftop size), then the maximum investments in 0–6 kW, 6–10 kW, 10–30 kW, 30–100 kW and >100 kW PV units are 0.53 GW, 0.77 GW, 2.29 GW, 0.82 GW and 0.33 GW, respectively.

#### 4.2.2. Sensitivity scenario results

Fig. 6 illustrates the changes compared to the Baseline of the total investment capacities of PV and batteries in the canton of Zurich for each sensitivity scenario in 2050. Focusing on the PV investment results, several different scenarios result in a similar cumulative PV capacity to the Baseline, (i.e. costs SC1–SC2, load profiles SL and WACC values SW1–SW2). In contrast, the optimal PV investment capacity is highly sensitive to the electricity price developments (i.e., SP1–SP10), with the lowest/highest price scenario (i.e., SP1/SP9) yielding the lowest/highest level of PV integration. Alternatively, the cumulative battery energy and power capacities vary significantly among scenarios, with the lowest battery capacity invested in the aggregated load scenario SL and the highest battery capacity invested in the low cost scenario SC2. Considering price scenarios SP1–SP10, the highest total battery investment capacity is obtained under the price scenario SP7 (i.e., highest retail price increase of 2%/year and lowest wholesale price increase of –1%/year), while the lowest battery investment is obtained under the price scenario SP3 (i.e., lowest retail price increase of 0%/year and highest wholesale price increase of 3%/year). This is likely due to the fact that a smaller spread between wholesale and retail electricity prices in turn decreases the profitability of battery investments in 2050, when in general more PV is invested than required for the consumers’ demand and the battery investment is driven more by shifting the PV injection from low to high wholesale electricity price hours than to increase the SCR.

#### 4.3. Results for Switzerland

In this section, only results for the Baseline scenario and for years 2020, 2030, 2040 and 2050 are shown. The results consider all 26 regions (i.e., cantons) in Switzerland with 2200 customer groups within each region. The combination of all these customer groups represents 3’795’145 individual consumers/households and a rooftop area of 224 km<sup>2</sup>, which is equivalent to a cumulative PV potential of 37 GW.


Since the investment decisions are optimized by maximizing the NPV of the investment, the resulting PBP could be up to the lifetime of the PVB system (i.e., 30 years). However, most investors would expect a PBP that is much shorter than the lifetime of the PVB system. The PBP of the currently installed PVB systems varies across countries, locations and customer groups. A recent study [76] conducted in Australia shows a PBP of 5 to 12 years, whereas some research [77] suggests that the PBP could be as long as 16 years.

Investments that result in long PBPs are likely not of high interest to customers. We therefore focus on two cases and define them as follows:


- **Fast recoverable** investment: PBP is less than 10 years;
- **Moderately fast recoverable** investment: PBP is less than 15 years.

##### 4.3.1. Baseline results - investment


Fig. 7 shows the optimal investments in Switzerland between 2020–2050. Each year is represented by a whisker plot where each value within this plot represents the cumulative capacity that is built in Switzerland with a PBP from zero to 30 years. The investment decision

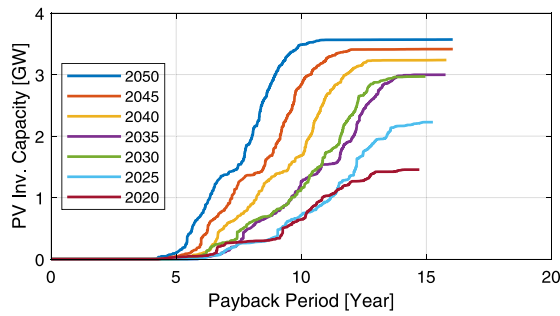

(a) PV investment capacity

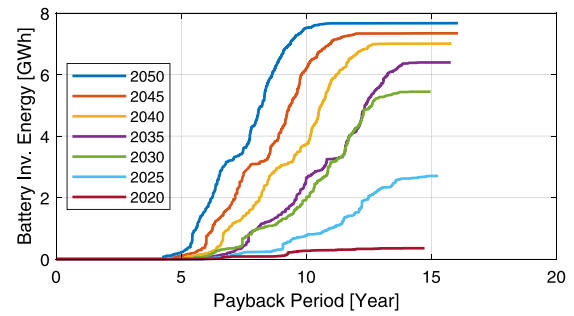

(b) Battery investment energy capacity

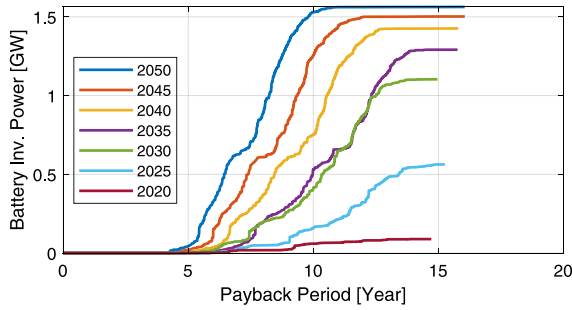

(c) Battery investment power capacity

Fig. 5. Optimal investment against PBP of the Baseline scenario of 2020–2050 for the canton of Zurich.

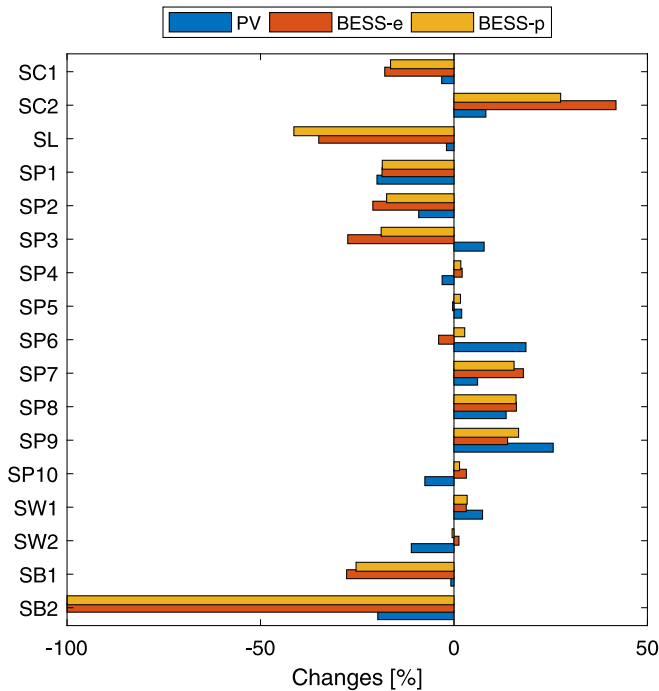


Fig. 6. Investment changes in the example of the canton of Zurich under different scenarios.

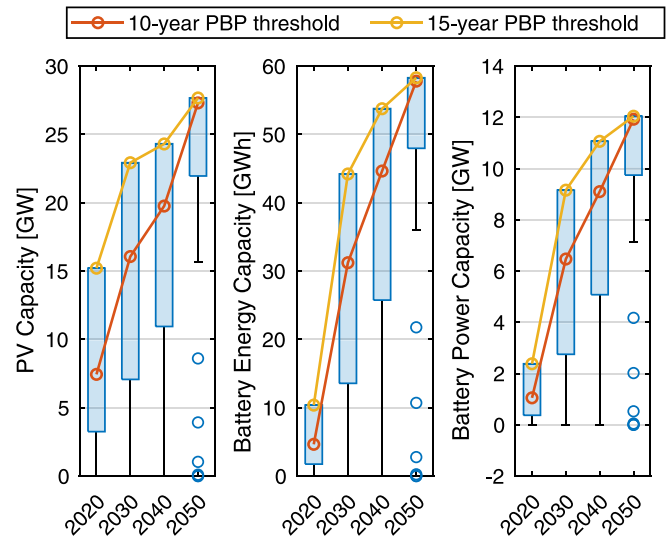


Fig. 7. Optimal yearly investment under different PBPs.

investments have a PBP shorter than 15 years,<sup>6</sup> which can also be seen in Fig. 5. In 2050, almost all investments achieve a PBP of less than 10 years.

Fig. 8 shows the regional investment capacities of fast recoverable and moderately fast recoverable investments in both 2020 and 2050,

<sup>6</sup> The investment decisions are optimized by maximizing the net present value over the 30-year lifetime of the PVB system, which is not equivalent to allow all investments that have a PVB below 30 years. This is because the NPV is calculated considering the time value of the money, which is not the case when calculating the PBP.

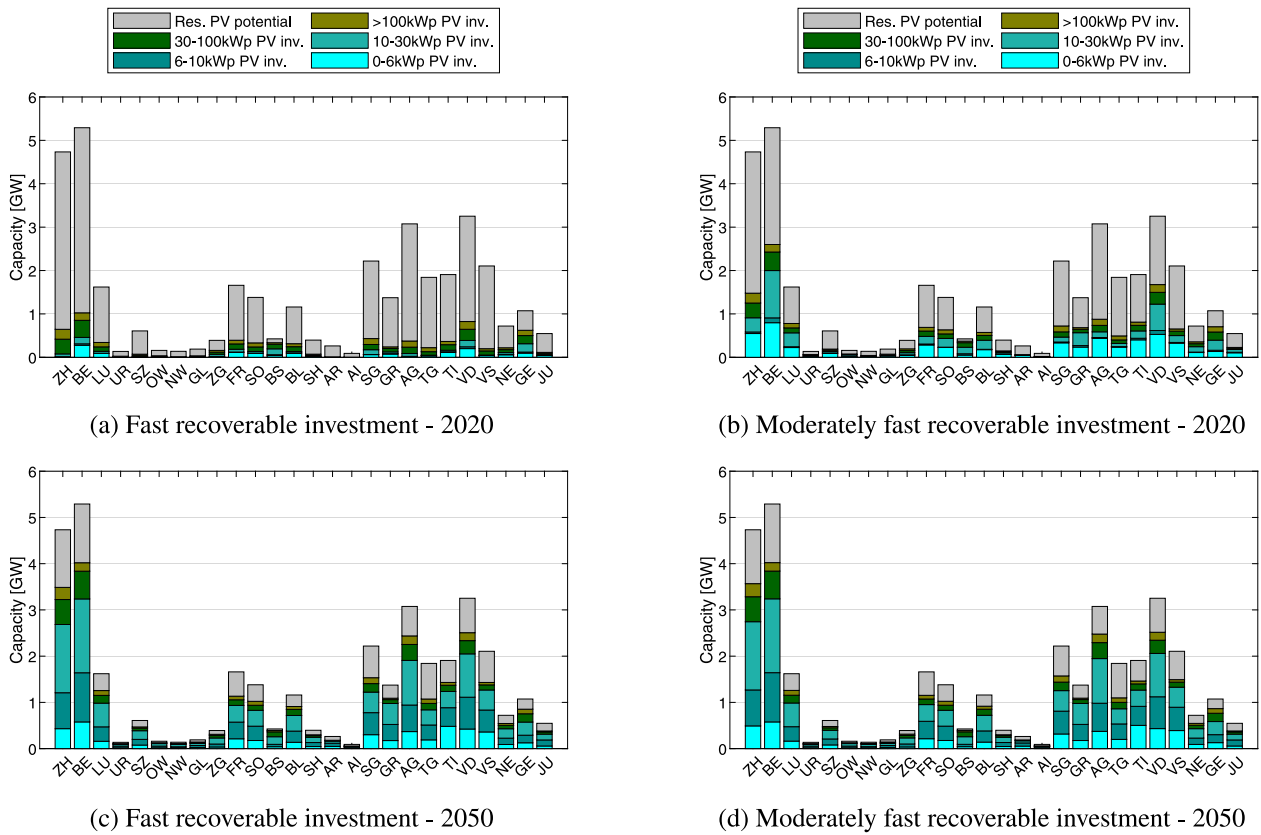


Fig. 8. Optimal regional investment of a fast and a moderately fast recoverable investment cases of the Baseline scenario in 2020 and 2050.

and PV investments are broken down into different PV size categories. In 2020, the fast recoverable investments are mainly large PV units. In cantons with high DSO injection tariffs (e.g. BS and GE), a significant share of deployment potentials is already qualified as fast recoverable in 2020. While in 2050, the fast recoverable investments are more evenly distributed between different regions and different PV categories. Moreover, profitable PV investment capacities increase while the corresponding PBPs decrease from 2020 to 2050.

Fig. 8(d) presents distributions of the fast recoverable investments in 2050 over different irradiation, rooftop size and annual electricity consumption categories. It can be noticed in Fig. 9(a) and Fig. 9(b) that the most attractive investments mainly belong to the customer groups that are in the higher annual irradiation and higher electricity consumption categories. Furthermore, the optimal PV investment size is generally limited by the rooftop size, as illustrated in Fig. 9(c) with the separated ordering of the colored PV categories from light to dark green, which shows the importance of considering rooftop size limits in the techno-economic model.

#### 4.3.2. Baseline results - self-consumption

Table 10 shows the Baseline self-consumption results analysis for the fast and moderately fast recoverable investments from 2020 to 2050. It can be seen that in both cases while the PV generation increases over time, the SCR peaks in 2040 since later investments are more driven by the low cost of the PVB system than by trying to increase the SCR. We can now also analyze the inherent losses for the retailers and DSOs caused by the reduced electricity purchase and compute by how much they would have to increase the retail price in order to recover these losses. The extra retail electricity tariff charge is calculated as the revenue loss of the DSOs divided by the sum of the residual load. This residual load represents the Swiss demand that

is not supplied by the invested PVB units, which is equal to the Swiss load minus the consumers' load that is self-supplied by the invested PVB units and minus the excess PV generation that is injected into the grid. The revenue loss is assumed to be equal to the savings earned by end-consumers on their electricity bills as a result of self-consumed PV generation instead of purchasing from the grid. From Table 10 it can be seen that this extra required retail electricity tariff calculated rises significantly over the years, especially from 2040 to 2050, which is due to the strong increase in self-consumption savings and the reduction in residual loads. Using the Swiss average household tariff in 2020 (i.e., 18.8 cent/kWh [78]) as a reference, the 12.6 cent/kWh and the 15.4 cent/kWh required tariff increase in 2050 in the fast and moderately fast recoverable investment cases translate into a total increase of 67% and 82%, which is equivalent to a yearly increase of 1.7% and 2.0% between 2020–2050. This of course is a simplified analysis as it does not take into account the rebound effect on PV and battery investments that would be driven by the increase in these retail prices but it points to an important issue that retailers and DSOs will likely face in the future.

## 5. Discussions

### 5.1. From investors' perspective

Results show that combining a battery with a PV unit is in some cases already economically viable today and especially for investors that have high annual electricity consumption. Ref. [23] analyzes households in Switzerland and demonstrates that almost all households with an annual demand of 7000 kWh reach profitability. A recently published report [79] shows that around 15% of residential PV systems are coupled with battery storage in 2020. However, the average

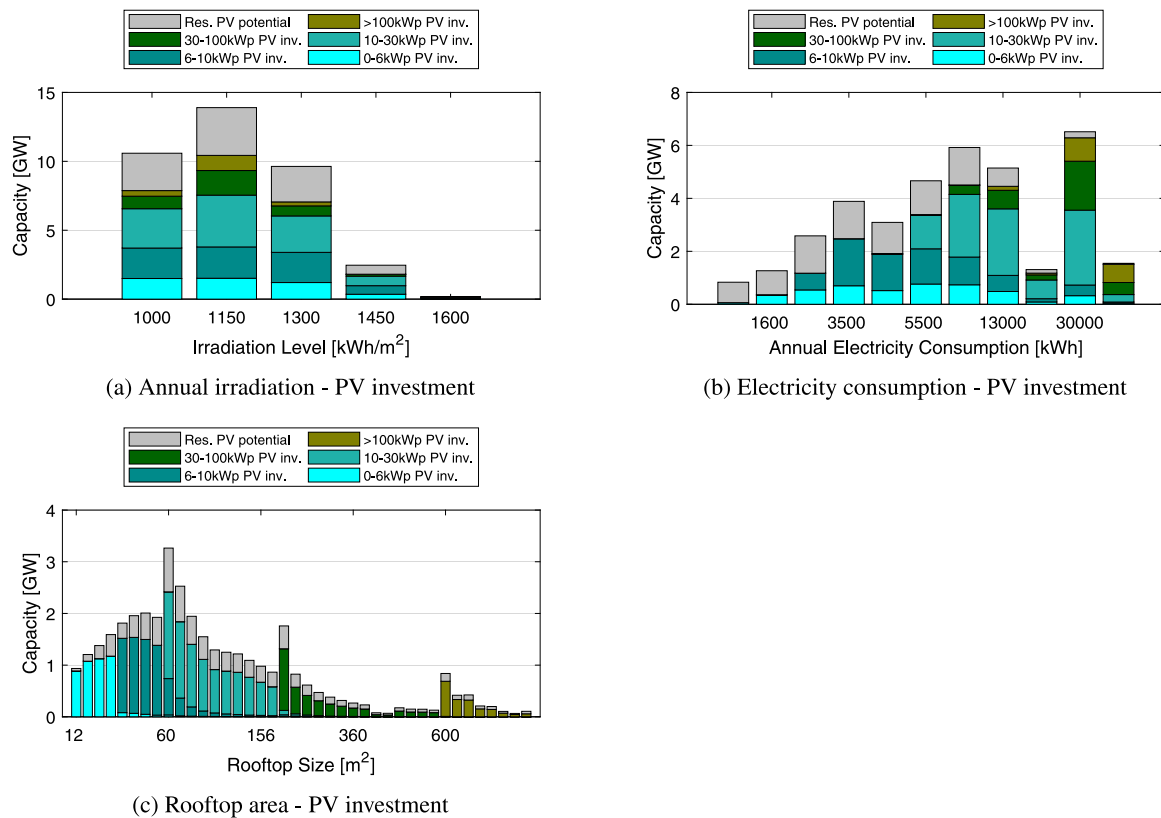


Fig. 9. Distribution of the fast recoverable investment of the Baseline scenario in 2050.

**Table 10**  
Baseline self-consumption results analysis for the fast/moderately fast recoverable investments, years 2020–2050.

Year	PV generation [TWh]	SCR	Savings [bn. EURs]	Required retail tariff increase [cent/kWh]
2020	3.5/14.3	54%/64%	0.4/1.8	0.7/4.3
2030	8.7/22.2	74%/72%	1.4/3.4	3.0/9.7
2040	13.1/23.9	76%/73%	2.4/4.0	5.6/12.0
2050	24.0/27.3	68%/67%	4.2/4.7	12.6/15.4

payback period might fluctuate between 2020 and 2035 mainly due to the mixed impacts of subsidy policy changes, cost reductions, injection tariff and electricity price developments. A significant decrease of the PBP is expected after 2040.

In addition, profitability and optimal size of the PVB system vary among consumer groups due to their diverse annual electricity consumption, locations, solar irradiation and rooftop sizes. It is therefore important to consider the heterogeneity of different investors when assessing the economic viability of the investment. The work [23] shows large variance in profitability even for households with comparable annual demand and emphasizes the needs to consider heterogeneity in load profiles.

Furthermore, the economics of the PVB system are especially sensitive to PV and battery cost developments [19,23–25], injection tariff changes and wholesale and retail electricity price changes [26,28,30]. Having access to the wholesale market can either increase or decrease the economic viability of the PVB system, depending on how the retail and wholesale electricity prices develop in the future and their relationship to each other. The deciding effect of the spread of the wholesale and retail electricity prices on the economic viability of the PV battery storage was also identified in [6].

Please note that the assumptions made in this work heavily affect our results obtained from the scenario simulations and idealistic motivations, i.e., non-economical reasons, to install PV and battery units are not captured. Therefore, we do not claim that the optimized investment decisions will be realized, given the modeled regulatory and legislative framework. However, the results indicate how the development of costs and electricity prices over the years affect the PVB system investment and operation decisions. Also, sensitivity analyses are conducted to better understand how our assumptions on different parameters (e.g., payback period and unit costs) affect the potential investments in PVB systems. To explore the impacts of socioeconomic and sociocultural characteristics on investment behaviors, agent-based modeling is often applied [80].

### 5.2. From retailers' perspective

According to our results with respect to the fast and moderately fast recoverable investments, by the end of 2050, 24.0 TWh and 27.3 TWh of the PV generation, which account for 37.9% and 43.1% of the total Swiss demand in 2019 (i.e. 63.4 TWh), could be self-consumed by the end-consumers. The resulting revenue losses from the decrease in electricity purchases of the prosumers could be recovered by increasing

**Table 11**  
Baseline PV cost scenario for 2020–2050 [42,73].

		2020	2030	2040	2050
PV investment cost (€/kWp)	0–6 kWp	2'496	2'060	1'770	1'654
	6–10 kWp	2'393	1'964	1'578	1'204
	10–30 kWp	1'916	1'572	1'308	1'102
	30–100 kWp	1'272	1'036	895	816
	>100 kWp	814	664	573	523
PV operational cost (cent/kWh)	0–6 kWp	2.6	2.1	1.9	1.7
	6–10 kWp	2.6	2.1	1.8	1.7
	10–30 kWp	2.6	2.1	1.8	1.7
	30–100 kWp	2.6	2.1	1.8	1.7
	>100 kWp	1.7	1.4	1.2	1.2

**Table 12**  
High cost scenario for 2020–2050 [42,73].

		2020	2030	2040	2050
PV investment cost (€/kWp)	0–6 kWp	2'786	2'322	2'060	1'857
	6–10 kWp	2'546	2'241	1'854	1'411
	10–30 kWp	2'066	1'813	1'561	1'308
	30–100 kWp	1'382	1'225	1'083	989
	>100 kWp	885	784	694	633
PV operational cost (cent/kWh)	0–6 kWp	2.6	2.2	1.9	1.7
	6–10 kWp	2.6	2.2	1.9	1.7
	10–30 kWp	2.6	2.2	1.9	1.7
	30–100 kWp	2.6	2.2	1.9	1.7
	>100 kWp	1.7	1.5	1.3	1.2

**Table 13**  
Low PV cost scenario for 2020–2050 [42,73].

		2020	2030	2040	2050
PV investment cost (€/kWp)	0–6 kWp	2'351	1'799	1'480	1'422
	6–10 kWp	2'241	1'715	1'300	996
	10–30 kWp	1'790	1'354	1'056	996
	30–100 kWp	1'178	864	691	644
	>100 kWp	754	553	442	412
PV operational cost (cent/kWh)	0–6 kWp	2.6	2.1	1.9	1.7
	6–10 kWp	2.6	2.1	1.8	1.7
	10–30 kWp	2.6	2.1	1.8	1.7
	30–100 kWp	2.6	2.1	1.8	1.7
	>100 kWp	1.7	1.4	1.2	1.1

**Table 14**  
Baseline battery cost scenario for 2020–2050 [43].

	2020	2025	2030	2035	2040	2045	2050
Investment cost (energy-related) €/kWh	377	233	158	123	110	103	96
Investment cost (power-related) €/kW	319	197	133	104	93	87	81
Operation cost (energy-related) €/MWh	1.41	0.87	0.59	0.46	0.41	0.38	0.36
Operation cost (power-related) €/kW-year	4.70	2.91	1.97	1.54	1.37	1.28	1.20

the retail electricity tariff. However, a higher retail electricity tariff will in turn further encourage investments in PV and battery units.

The current retail electricity tariff (including the grid tariff) scheme is mainly energy-based (i.e. electricity charged based on the kWh of electricity consumed). Although the PVB system investments tend to decrease the annual net electricity consumption, the possibly higher dynamics of their residual load profile and the absolute value of their peak net-load will increase the burden on the grid. Therefore, an additional capacity-based grid tariff, which is proposed in [81,82], could enable a more reasonable pricing scheme and incentivize the prosumers

to optimize their dispatch more in favor of the grid. Furthermore, a three-part demand tariff that comprises a fixed charge, a variable kWh charge, and a maximum kW demand charge is presented in [83].

However, it is also worth mentioning that the future load profile is also subject to uncertainties brought by the electrification of heating and the transportation sector, which could compensate the loss of the self-consumption or further exacerbate the problem by increasing the self-consumption. According to the recent IEA (International Energy Agency) report [84], the global electricity demand is projected to reach almost 80% above today's level.



**Table 15**  
High battery cost scenario for 2020–2050 [43].

	2020	2025	2030	2035	2040	2045	2050
Investment cost (energy-related) €/kWh	459	329	247	206	178	171	158
Investment cost (power-related) €/kW	388	278	209	174	151	145	133
Operation cost (energy-related) €/MWh	1.72	1.23	0.92	0.77	0.67	0.64	0.59
Operation cost (power-related) €/kW-year	5.73	4.10	3.08	2.56	2.22	2.14	1.97

**Table 16**  
Low battery cost scenario for 2020–2050 [43].

	2020	2025	2030	2035	2040	2045	2050
Investment cost (energy-related) €/kWh	295	137	69	41	41	34	34
Investment cost (power-related) €/kW	249	116	58	35	35	29	29
Operation cost (energy-related) €/MWh	1.10	0.51	0.26	0.15	0.15	0.13	0.13
Operation cost (power-related) €/kW-year	3.68	1.71	0.85	0.51	0.51	0.43	0.43

**Table 17**  
The DSO injection tariff in cent/kWh for PV is estimated for each Swiss Canton [62].

Index	Canton	2020	2025	2030	2035	2040	2045	2050
1	ZH	6.6	5.6	6.1	6.5	7.0	7.6	8.2
2	BE	6.9	5.6	6.1	6.5	7.0	7.6	8.2
3	LU	7.3	5.6	6.1	6.5	7.0	7.6	8.2
4	UR	9.0	5.6	6.1	6.5	7.0	7.6	8.2
5	SZ	7.0	5.6	6.1	6.5	7.0	7.6	8.2
6	OW	10.0	5.9	6.1	6.5	7.0	7.6	8.2
7	NW	5.9	5.6	6.1	6.5	7.0	7.6	8.2
8	GL	6.8	5.6	6.1	6.5	7.0	7.6	8.2
9	ZG	11.2	6.6	6.1	6.5	7.0	7.6	8.2
10	FR	8.5	5.6	6.1	6.5	7.0	7.6	8.2
11	SO	8.7	5.6	6.1	6.5	7.0	7.6	8.2
12	BS	11.8	7.0	6.1	6.5	7.0	7.6	8.2
13	BL	9.1	5.6	6.1	6.5	7.0	7.6	8.2
14	SH	7.3	5.6	6.1	6.5	7.0	7.6	8.2
15	AR	5.7	5.6	6.1	6.5	7.0	7.6	8.2
16	AI	9.1	5.6	6.1	6.5	7.0	7.6	8.2
17	SG	8.2	5.6	6.1	6.5	7.0	7.6	8.2
18	GR	9.1	5.6	6.1	6.5	7.0	7.6	8.2
19	AG	6.2	5.6	6.1	6.5	7.0	7.6	8.2
20	TG	7.3	5.6	6.1	6.5	7.0	7.6	8.2
21	TI	8.2	5.6	6.1	6.5	7.0	7.6	8.2
22	VD	7.4	5.6	6.1	6.5	7.0	7.6	8.2
23	VS	7.0	5.6	6.1	6.5	7.0	7.6	8.2
24	NE	8.5	5.6	6.1	6.5	7.0	7.6	8.2
25	GE	11.1	6.6	6.1	6.5	7.0	7.6	8.2
26	JU	6.9	5.6	6.1	6.5	7.0	7.6	8.2

### 5.3. From policy-makers' perspective

The optimization results in the Baseline scenario show that most PVB systems could result in positive NPV even without policy support after 2030. However, the payback periods of the invested projects fluctuate between 2020 and 2040 in the Baseline scenario, which indicates that there are competing influences that could reduce the economic attractiveness for customers. The increasing dynamics of residual load profiles require increased levels of flexibility provisions in the distribution and transmission networks while at the same time

lower DSO revenues are expected as a result of lower electricity purchases of prosumers. Ref. [85] demonstrates that the system flexibility requirements increase dramatically when the PV generation contributes to more than 30% of total electricity demand. Policy-makers therefore may have to rethink the market design and rules to not only promote investments in renewable generations but also in resources that are capable of providing the required flexibility. We believe that the sensitivity analyses in this work that assess the impacts of different input parameters enable policy-makers to identify the main driving factors for investments in PV and battery units.

**Table 18**

The base retail electricity tariff in cent/kWh estimated for each Swiss Canton and consumption group in 2020 [64].

Canton	L1	L2	L3	L4	L5	L6	L7	L8	L9	L10	L11
ZH	20.5	18.3	16.7	16.7	15.8	15.8	15.5	14.3	12.3	16.3	14.3
BE	27.7	25.1	23.1	23.1	22.1	22.1	22.2	19.7	17.6	22.3	19.9
LU	23.0	22.7	21.0	21.0	20.7	20.7	22.1	17.8	14.9	21.0	17.0
UR	28.4	25.5	23.3	23.3	22.2	22.2	22.2	19.2	15.8	20.9	16.7
SZ	23.9	21.7	20.1	20.1	19.2	19.2	18.7	16.9	15.0	19.2	16.7
OW	26.9	24.0	22.1	22.1	21.0	21.0	20.8	19.1	16.6	19.9	17.7
NW	24.2	21.4	19.9	19.9	18.8	18.8	18.1	17.0	15.6	17.5	16.1
GL	27.7	25.1	22.3	22.3	20.1	20.1	18.5	17.1	15.1	20.9	19.5
ZG	21.0	20.1	18.2	18.2	17.4	17.4	17.7	14.9	12.8	18.1	15.3
FR	24.5	22.2	20.1	20.1	19.3	19.3	19.8	17.3	14.0	19.9	19.1
SO	26.1	23.2	21.6	21.6	20.7	20.7	20.6	18.6	16.2	21.0	18.8
BS	27.4	27.2	25.8	25.8	25.9	25.9	27.3	23.1	21.0	29.6	25.6
BL	25.4	23.0	21.5	21.5	20.7	20.7	20.4	17.1	17.2	20.7	18.8
SH	24.8	22.1	20.6	20.6	19.6	19.6	19.1	16.4	15.3	19.3	16.7
AR	21.0	19.3	17.8	17.8	16.6	16.6	16.0	14.2	13.1	16.3	13.5
AI	22.2	19.2	17.6	17.6	16.5	16.5	15.9	14.3	13.0	16.2	14.1
SG	23.2	20.5	18.8	18.8	17.7	17.7	17.0	15.5	14.1	17.8	15.2
GR	24.9	22.2	21.1	21.1	20.4	20.4	20.4	18.8	16.6	19.9	19.6
AG	26.8	20.4	18.7	18.7	17.6	17.6	17.0	15.5	13.3	17.1	16.2
TG	23.2	20.6	19.0	19.0	17.9	17.9	17.3	15.9	14.3	18.6	16.5
TI	21.4	20.2	18.9	18.9	18.6	18.6	18.6	17.0	15.6	18.8	19.2
VD	24.1	22.6	20.9	20.9	20.2	20.2	20.5	18.3	15.7	20.3	17.7
VS	20.3	18.3	17.3	17.3	18.6	18.6	15.4	16.0	13.3	16.8	15.2
NE	25.4	23.8	21.4	21.4	20.1	20.1	20.2	18.0	14.9	21.1	18.8
GE	20.5	20.2	19.1	19.1	19.0	19.0	20.0	18.1	16.2	20.7	19.5
JU	32.2	28.6	26.3	26.3	25.3	25.3	25.6	21.1	17.6	25.5	21.8

Note: the low retail electricity tariff for off-peak hours and the high retail electricity tariff for peak hours are assumed to be 71% and 107% of the base tariff.

**Table 19**

Information of electricity consumption categories [64].

Category	Annual electricity consumption	Electricity tariff category
L1	0-1'600 kWh	H1
L2	1'600-2'500 kWh	H2
L3	2'500-3'500 kWh	H2, H3
L4	3'500-4'500 kWh	H2, H3
L5	4'500-5'500 kWh	H3, H4
L6	5'500-7'500 kWh	H3, H4
L7	7'500-13'000 kWh	H8
L8	13'000-25'000 kWh	H7
L9	25'000-30'000 kWh	H6
L10	30'000-150'000 kWh	C2
L11	>150'000 kWh	C3

## 6. Limitations and future work

This work has several limitations and a few of which are highlighted in this section. First, load profiles of different customer groups are estimated using a number of synthetic load profiles that undoubtedly deviate from real-world data. Thus, the variety of different consumption behaviors between various regions and sectors is not captured. Furthermore, due to the lack of input data, the annual electricity consumption of individual customers is approximated using the warm water consumption data; additionally, the annual electricity consumption value is assumed to be constant over the years, which does not capture the possibility of an increase in EV penetrations or other electrification. Future work should include a bottom-up representation of buildings' electricity demand by utilizing realistic load patterns that evolve from year to year and differ from region to region.

Second, the rooftop data are grouped using a limited number of clusters and represent each group using the median data. The groups with highly varied data and the groups with few data therefore cannot be well represented; this is especially important since these two cases mostly correspond to the groups with high electricity consumption or large roofs. However, increasing the number of clusters causes higher computational complexity and longer simulation time. In future work, a proper clustering method possibly is required and a comprehensive analysis is needed to investigate the impact of the clustering on the results.

Third, the investment behavior is modeled using a NPV-maximization objective without considering non-economic factors. A future version should account for a heterogeneous investor population, including, for example, varying risk profiles and cost-unrelated objectives such as peer-effects. These enhancements toward a diverse consumer perspective would enable a more realistic assessment of the investment decisions and their impacts on the grid. However, completing such improvements requires additional input data and increases the implementation overhead.

Fourth, the generated wholesale electricity price scenarios in the future are simulated by applying different multiplication factors to the historical wholesale market prices. However, in this way the price suppression effect of PVB system injections especially during high PV generation hours cannot be captured. In addition, because of the central hub position of Switzerland, the Swiss wholesale electricity prices are also impacted by generation mix changes in surrounding countries.

Sixth, the proposed investment model is static, which does not incorporate the optimization of the investment timing, i.e. does not account for the option to postpone the investment.

And finally, only rooftop solar potential is considered in this work considering its dominance in the total solar potential in Switzerland [86], while investment options such as solar facades and solar farms (including floating solar farms) are not incorporated. Furthermore, this work focuses on residential customer groups while ignoring potential investors from customer groups such as the industrial, service, or transportation sectors, as most rooftop solar potential in Switzerland

is from buildings with residential purposes [86]. A comprehensive dataset including various building types and investment options could be constructed and integrated in future work to represent the economic trade-offs for these other customer groups.

## 7. Conclusions

This paper presents a techno-economic optimization model to analyze the economic viability of PVB systems for different residential customer groups in Switzerland clustered based on their annual electricity consumption, rooftop size, annual irradiation, and region. There are in total 2200 customer groups considered for each of the 26 regions in Switzerland. Each of the customer groups is represented using median values for each of the dimensions that define the group. The optimization of a static investment model is carried out considering a greenfield investment for each of the investment years from 2020 through 2050 (i.e., each year run independently without taking investments from previous years into account). The resulting optimal decisions are then applied to all customers within the corresponding customer group. A comprehensive sensitivity analysis is conducted for an example of a particular canton (i.e., Zurich) in 2050 to investigate the impacts of input parameters such as costs, load profiles, electricity prices and tariffs on the optimal investment decisions.

Results show that the combined PV plus battery system investments for some customer groups already yield a better NPV than PV alone today. The payback period of PVB system investments fluctuates between 2020 and 2035 due to the mixed effects of policy changes, costs, and electricity price developments, but decreases significantly afterwards. The optimal PV and battery sizes increase over time, e.g. the weighted average investment size for PV of canton Zurich increases from 4.5 kW in 2020 to 9.2 kW in 2050, while the optimal size for battery increases dramatically from 1.1 kWh/0.3 kW in 2020 to 19.8 kWh/4.0 kW in 2050. In 2050, the PVB system investment is profitable for most customer groups and the PV investment with the shortest PBP is mostly limited by the rooftop size. Optimal investment decisions vary between different customer groups and fast recoverable investment (i.e., with the shortest PBP) is mostly accessible to customer groups that have high annual irradiation and electricity demand, which suggests that it is important to consider the heterogeneity of different customer groups when assessing the economic viability of PVB system investments. At the national level, the cumulative PV investments for Switzerland are expected to increase from 7 GW in 2020 to nearly 27 GW in 2050 considering the 10-year PBP, while the cumulative Swiss battery investments are expected to grow from 4 GWh/1 GW to 58 GWh/12 GW. Furthermore, the electricity purchases of the end-consumers decrease dramatically over the years since more consumers turn into prosumers. Such a change could require rethinking the current electricity tariff and subsidy policy design. In addition, investment decisions are highly sensitive to the expected payback periods, future costs, injection tariff developments, and wholesale and retail electricity price changes. For example, considering the one-at-a-time sensitivity analysis results for the investigated representative customer group, the optimal investment size ranges from 2.0 kW to 12.3 kW for PV and from 0 kWh/ 0 kW to 12.5 kWh/2.8 kW for the battery. It is therefore important to identify the driving factors of the PVB system investments and understand the future uncertainties of different input parameters when discussing the economic viability of PVB systems in the future.

## CRedit authorship contribution statement

**Xuejiao Han:** Conceptualization, Methodology / Study design, Software, Validation, Formal analysis, Investigation, Resources, Data curation, Writing – original draft, Writing – review & editing, Visualization. **Jared Garrison:** Conceptualization, Methodology / Study design, Validation, Formal analysis, Investigation, Resources, Writing – review & editing, Visualization. **Gabriela Hug:** Conceptualization, Methodology / Study design, Validation, Resources, Writing – review & editing, Supervision, Project administration, Funding acquisition.

## Declaration of competing interest

The authors declare that they have no known competing financial interests or personal relationships that could have appeared to influence the work reported in this paper.

## Acknowledgments

The authors would like to thank the Swiss Federal Office of Energy (SFOE) for supporting the Nexus-e project (Nr. SI/501460). The views and opinions in this paper are those of the authors and do not necessarily reflect the position of SFOE.

## Appendix A. Input data of a low, baseline and high cost scenario for PV units

See Tables 11–13.

## Appendix B. Input data of a low, baseline and high cost scenario for battery units

See Tables 14–16.

## Appendix C. Assumed DSO injection tariff by canton

See Table 17.

## Appendix D. Assumed retail electricity tariff by canton

See Tables 18 and 19.

## References

- [1] Hoesung Lee, Fatih Birol. Energy is at the heart of the solution to the climate challenge. 2020, <https://www.ipcc.ch/2020/07/31/energy-climatechallenge>. [Accessed 11 October 2020].
- [2] International Energy Agency. Photovoltaic power systems programme annual report. International Energy Agency; 2019.
- [3] PVPS IEA. Snapshot of global photovoltaic markets. Report IEA PVPS T1-37, 2020.
- [4] Han Xuejiao, Hug Gabriela. A distributionally robust bidding strategy for a wind-storage aggregator. *Electr Power Syst Res* 2020;189:106745.
- [5] Stephan Annegret, Battke Benedikt, Beuse MD, Clausdeinken J Hendrik, Schmidt Tobias S. Limiting the public cost of stationary battery deployment by combining applications. *Nat. Energy* 2016;1(7):16079.
- [6] Hoppmann Joern, Volland Jonas, Schmidt Tobias S, Hoffmann Volker H. The economic viability of battery storage for residential solar photovoltaic systems—A review and a simulation model. *Renew Sustain Energy Rev* 2014;39:1101–18.
- [7] Truong Cong Nam, Naumann Maik, Karl Ralph Ch, Müller Marcus, Jossen Andreas, Hesse Holger C. Economics of residential photovoltaic battery systems in Germany: The case of Tesla's Powerwall. *Batteries* 2016;2(2):14.
- [8] Merei Ghada, Moshövel Janina, Magnor Dirk, Sauer Dirk Uwe. Optimization of self-consumption and techno-economic analysis of PV-battery systems in commercial applications. *Appl Energy* 2016;168:171–8.
- [9] Kaschub Thomas, Jochem Patrick, Fichtner Wolf. Solar energy storage in german households: profitability, load changes and flexibility. *Energy Policy* 2016;98:520–32.
- [10] Nyholm Emil, Goop Joel, Odenberger Mikael, Johnsson Filip. Solar photovoltaic-battery systems in Swedish households—self-consumption and self-sufficiency. *Appl Energy* 2016;183:148–59.
- [11] Khalilpour Kaveh Rajab, Vassallo Anthony. Technoeconomic parametric analysis of PV-battery systems. *Renew Energy* 2016;97:757–68.
- [12] Quoilin Sylvain, Kavvadias Konstantinos, Mercier Arnaud, Pappone Irene, Zucker Andreas. Quantifying self-consumption linked to solar home battery systems: Statistical analysis and economic assessment. *Appl Energy* 2016;182:58–67.
- [13] Camilo Fernando M, Castro Rui, Almeida ME, Pires V Fernao. Economic assessment of residential PV systems with self-consumption and storage in Portugal. *Sol Energy* 2017;150:353–62.
- [14] Linssen Jochen, Stenzel Peter, Fler Johannes. Techno-economic analysis of photovoltaic battery systems and the influence of different consumer load profiles. *Appl Energy* 2017;185:2019–25.

- [15] Bertsch Valentin, Geldermann Jutta, Lühn Tobias. What drives the profitability of household PV investments, self-consumption and self-sufficiency? *Appl Energy* 2017;204:1–15.
- [16] Zhang Yang, Campana Pietro Elia, Lundblad Anders, Yan Jinyue. Comparative study of hydrogen storage and battery storage in grid connected photovoltaic system: Storage sizing and rule-based operation. *Appl Energy* 2017;201:397–411.
- [17] Uddin Kotub, Gough Rebecca, Radcliffe Jonathan, Marco James, Jennings Paul. Techno-economic analysis of the viability of residential photovoltaic systems using lithium-ion batteries for energy storage in the united kingdom. *Appl Energy* 2017;206:12–21.
- [18] Hassan Abubakar Sani, Cipcigan Liana, Jenkins Nick. Optimal battery storage operation for PV systems with tariff incentives. *Appl Energy* 2017;203:422–41.
- [19] Vieira Filomeno M, Moura Pedro S, de Almeida Anibal T. Energy storage system for self-consumption of photovoltaic energy in residential zero energy buildings. *Renew Energy* 2017;103:308–20.
- [20] e Silva Guilherme de Oliveira, Hendrick Patrick. Photovoltaic self-sufficiency of belgian households using lithium-ion batteries, and its impact on the grid. *Appl Energy* 2017;195:786–99.
- [21] Akter MN, Mahmud MA, Oo Amanullah MT. Comprehensive economic evaluations of a residential building with solar photovoltaic and battery energy storage systems: An Australian case study. *Energy Build* 2017;138:332–46.
- [22] Barcellona Simone, Piegari Luigi, Musolino Vincenzo, Ballif Christophe. Economic viability for residential battery storage systems in grid-connected PV plants. *IET Renew Power Gener* 2017;12(2):135–42.
- [23] Schopfer Sandro, Tiefenbeck Verena, Staake Thorsten. Economic assessment of photovoltaic battery systems based on household load profiles. *Appl Energy* 2018;223:229–48.
- [24] Tervo Eric, Agbim Kenechi, DeAngelis Freddy, Hernandez Jeffrey, Kim Hye Kyung, Odukumaiya Adewale. An economic analysis of residential photovoltaic systems with lithium ion battery storage in the United States. *Renew Sustain Energy Rev* 2018;94:1057–66.
- [25] Litjens GBMA, Worrell E, Van Sark WGJHM. Economic benefits of combining self-consumption enhancement with frequency restoration reserves provision by photovoltaic-battery systems. *Appl Energy* 2018;223:172–87.
- [26] Say Kelvin, John Michele, Dargaville Roger. Power to the people: Evolutionary market pressures from residential p.v. battery investments in Australia. *Energy Policy* 2019;134:110977.
- [27] Bai Bo, Xiong Siqin, Song Bo, Xiaoming Ma. Economic analysis of distributed solar photovoltaics with reused electric vehicle batteries as energy storage systems in China. *Renew Sustain Energy Rev* 2019;109:213–29.
- [28] Koskela Juha, Rautiainen Antti, Järventausta Pertti. Using electrical energy storage in residential buildings—sizing of battery and photovoltaic panels based on electricity cost optimization. *Appl Energy* 2019;239:1175–89.
- [29] Lazzeroni Paolo, Moretti Francesco, Stirano Federico. Economic potential of PV for Italian residential end-users. *Energy* 2020;117508.
- [30] Chaianong Aksornchan, Bangvivat Athikom, Menke Christoph, Breitschopf Barbara, Eichhammer Wolfgang. Customer economics of residential PV–battery systems in Thailand. *Renew Energy* 2020;146:297–308.
- [31] Dhundhara Sandeep, Verma Yajvender Pal, Williams Arthur. Techno-economic analysis of the lithium-ion and lead-acid battery in microgrid systems. *Energy Convers Manage* 2018;177:122–42.
- [32] Abdon Andreas, Zhang Xiaojin, Parra David, Patel Martin K, Bauer Christian, Worlitschek Jörg. Techno-economic and environmental assessment of stationary electricity storage technologies for different time scales. *Energy* 2017;139:1173–87.
- [33] Bundesamt für Energie. Energiestrategie 2050. 2020, <https://www.bfe.admin.ch/bfe/de/home/politik/energiestrategie-2050.html>. [Accessed 25 December 2020].
- [34] Bundesamt für Energie. Schweizer Hausdächer und -fassaden könnten jährlich 67 TWh Solarstrom produzieren. 2020, <https://www.bfe.admin.ch/bfe/de/home/news-und-medien/medienmitteilungen/mm-test.msg-id-74641.html>. [Accessed 31 August 2020].
- [35] Swissolar. 2.5 Gigawatt installierte solarleistung: wir brauchen 20-mal mehr. 2020, <https://www.swissolar.ch/services/medien/news/detail/n-n/25-gigawatt-installierte-solarleistung-wir-brauchen-20-mal-mehr/>. Accessed 31 August 2020.
- [36] Hostettler Thomas. Markterhebung sonnenenergie. 2020, <https://www.swissolar.ch/ueber-solarenergie/fakten-und-zahlen/markterhebungen>. [Accessed 01 February 2020].
- [37] Bundesamt für Energie. Berechnung von potenzialen in gemeinden. 2020, <https://www.bfe.admin.ch/bfe/de/home/versorgung/statistik-und-geodaten/geoinformation/geodaten/solar/solarenergie-eignung-hausdach.html>. [Accessed 23 June 2020].
- [38] Paschotta Rüdiger. Warmwasser. 2020, <https://www.energie-lexikon.info/warmwasser.html>. [Accessed 31 August 2020].
- [39] Volkshochschulen Die Wiener. Warmes wasser: Effizient herstellen und sparsam nutzen. 2017, <https://www.umweltberatung.at/download/?id=warmes-wasser-3073-umweltberatung.pdf>. [Accessed 31 August 2020].
- [40] Rheinisch-Westfälisches Institut für Wirtschaftsforschung (RWI) and forsa Gesellschaft für Sozialforschung und statistische Analysen mbH. The german residential energy consumption survey 2009–2010. 2010, [http://www.rwi-essen.de/media/content/pages/publikationen/rwi-projektberichte/PB\\_Energieverbrauch-priv-HH-2009-2010\\_K\\_E.pdf](http://www.rwi-essen.de/media/content/pages/publikationen/rwi-projektberichte/PB_Energieverbrauch-priv-HH-2009-2010_K_E.pdf). [Accessed 31 August 2020].
- [41] Axpo. Electricity market facts and figures. <https://www.axpo.com/ch/en/about-us/media-and-politics/power-market-switzerland.html>.
- [42] Christian Bauer, Stefan Hirschberg, et al. Potentials, costs and environmental assessment of electricity generation technologies. Technical report, PSI, WSL, ETHZ, EPFL. Paul Scherrer Institut, Switzerland; 2017.
- [43] Schmidt Oliver, Melchior Sylvain, Hawkes Adam, Staffell Iain. Projecting the future leveled cost of electricity storage technologies. *Joule* 2019;3(1):81–100.
- [44] Schweizerische Bundesrat. Verordnung über die förderung der produktion von elektrizität aus erneuerbaren energien. 2017, <https://www.admin.ch/opc/de/classified-compilation/20162947/index.html#a7>. [Accessed 23 June 2020].
- [45] Gupta Ruchi, Soini Martin Christoph, Patel Martin Kumar, Parra David. Levelized cost of solar photovoltaics and wind supported by storage technologies to supply firm electricity. *J Energy Storage* 2020;27:101027.
- [46] Lebedeva N. Li-ion batteries for mobility and stationary storage applications. Publications Office of the European Union; 2018.
- [47] Nykvist Björn, Nilsson Måns. Rapidly falling costs of battery packs for electric vehicles. *Nature Clim Change* 2015;5(4):329–32.
- [48] Cole Wesley J, Marcy Cara, Krishnan Venkat K, Margolis Robert. Utility-scale lithium-ion storage cost projections for use in capacity expansion models. In: 2016 North american power symposium. IEEE; 2016, p. 1–6.
- [49] Ardani Kristen, O'Shaughnessy Eric, Fu Ran, McClurg Chris, Huneycutt Joshua, Margolis Robert. Installed cost benchmarks and deployment barriers for residential solar photovoltaics with energy storage: Q1 2016. Technical report, National Renewable Energy Lab (NREL), Golden, CO, United States; 2016.
- [50] Curry Claire. Lithium-ion battery costs and market. *Bloomberg New Energy Finance* 2017;5:4–6.
- [51] Ralon Pablo, Taylor Michael, Ilas Andrei, Diaz-Bone Harald, Kairies K. Electricity storage and renewables: Costs and markets to 2030. Abu Dhabi, UAE: International Renewable Energy Agency; 2017.
- [52] Schmidt Olivier, Hawkes Adam, Gambhir Ajay, Staffell Iain. The future cost of electrical energy storage based on experience rates. *Nat. Energy* 2017;2:17110.
- [53] Few Sheridan, Schmidt Oliver, Offer Gregory J, Brandon Nigel, Nelson Jenny, Gambhir Ajay. Prospective improvements in cost and cycle life of off-grid lithium-ion battery packs: An analysis informed by expert elicitations. *Energy Policy* 2018;114:578–90.
- [54] Lazard. Lazard's leveled cost of storage analysis. 2018, <https://www.lazard.com/media/450774/lazards-levelized-cost-of-storage-version-40-vfinal.pdf>. [Accessed 11 September 2020].
- [55] Mongird Kendall, Viswanathan Vilayanur V, Balducci Patrick J, Alam Md Jan E, Fotedar Vanshika, Koritarov VS, et al. Energy storage technology and cost characterization report. Technical report, Richland, WA, United States: Pacific Northwest National Lab (PNNL); 2019.
- [56] Pflugradt Noah. Load profile generator. 2017, Available at: <https://www.loadprofilgenerator.de/>.
- [57] für Energie Bundesamt. Wie viel strom oder wärme kann mein dach produzieren?. 2020, <https://www.uvek-gis.admin.ch/BFE/sonnedach>. [Accessed 23 June 2020].
- [58] of Meteorology Federal Swiss, MeteoSwiss Climatology. IDAWEB [online]. <https://gate.meteoswiss.ch/idaweb>.
- [59] A.G. Pronovo. Datensatz PV installationen in der schweiz. 2020.
- [60] Swissolar. Direktvermarktung. 2020, <https://pronovo.ch/de/foerderung/evs/direktvermarktung/>. [Accessed 31 August 2020].
- [61] Spaes Joël. Switzerland Renews support for renewables. 2020, <https://www.pv-magazine.com/2020/04/08/switzerland-renews-support-for-renewables>. [Accessed 31 August 2020].
- [62] Fischer Diego. pvtarif.ch Jahresbericht 2018. 2018, <https://www.vese.ch/wp-content/uploads/pvtarif-ch-Weiterführung-2017-2020-Jahresbericht-2019-1.pdf>. [Accessed 23 June 2020].
- [63] energieschweiz. Fördergelder und Vergütungen. 2020, <https://www.energieschweiz.ch/page/de-ch/Foerdergelder-und-Verguetungen>. [Accessed 23 June 2020].
- [64] Swiss Federal Authorities. Die kantonalen strompreise im vergleich. 2020, <https://www.strompreis.elcom.admin.ch/Map/ShowSwissMap.aspx>. [Accessed 01 February 2020].
- [65] European Power Exchange. EPEX market data [online]. 2019, Available: <https://www.epexspot.com/en/market-data>.
- [66] Eidgenossenschaft Schweizer. Energieverordnung per 1. November 2017. 2017, <https://www.admin.ch/opc/de/classified-compilation/20162945/index.html>. [Accessed 31 March 2020].
- [67] Grabowski Roger J, Pratt Shannon P. Cost of capital: Applications and examples. John Wiley & Sons; 2014.
- [68] Luthander Rasmus, Widén Joakim, Nilsson Daniel, Palm Jenny. Photovoltaic self-consumption in buildings: A review. *Appl Energy* 2015;142:80–94.
- [69] Mundada Aishwarya S, Shah Kunal K, Pearce Joshua M. Levelized cost of electricity for solar photovoltaic, battery and cogen hybrid systems. *Renew Sustain Energy Rev* 2016;57:692–703.
- [70] Lai Chun Sing, McCulloch Malcolm D. Levelized cost of electricity for solar photovoltaic and electrical energy storage. *Appl Energy* 2017;190:191–203.
- [71] National Renewable Energy Laboratory (NREL). Levelized cost of solar plus storage. 2020, <https://www.nrel.gov/news/video/lcoss-text.html>.

- [72] Bundesamt für Energie (BFE). Schweizerische Elektrizitäts Statistik 2019. Bundesamt für Energie BFE; 2019.
- [73] Bauer Christian, Cox Brian, Heck Thomas, et al. Potential, costs and environmental assessment of electricity generation technologies: An update of potentials and electricity generation costs. Technical report, PSI; 2019.
- [74] Tesla. Powerwall. 2020, [https://www.tesla.com/de\\_CH/powerwall](https://www.tesla.com/de_CH/powerwall). [Accessed 01 FEBRUARY 2020].
- [75] Sonnen. Sonnenbatterie. 2020, <https://sonnen.de/stromspeicher/>. [Accessed 28 October 2020].
- [76] Solar Choice. Solar batteries – are they worth it?. 2020, <https://www.solarchoice.net.au/is-home-battery-storage-worth-it/>. [Accessed 28 October 2020].
- [77] Meredith Steven. Do I need a battery system and what's the payback period?. 2017, <https://www.renewableenergyhub.co.uk/blog/do-i-need-a-battery-system-and-whats-the-payback-period/>. [Accessed 28 October 2020].
- [78] Valev Neven. Switzerland Electricity prices. 2020, [https://de.globalpetrolprices.com/Switzerland/electricity\\_prices/](https://de.globalpetrolprices.com/Switzerland/electricity_prices/). [Accessed 11 October 2020].
- [79] Thomas Hostettler, Andreas Hekler. Statistik sonnenenergie referenzjahr 2020. Bundesamt für Energie BFE; 2021.
- [80] Stavrakas Vassilis, Papadelis Sotiris, Flamos Alexandros. An agent-based model to simulate technology adoption quantifying behavioural uncertainty of consumers. *Appl Energy* 2019;255:113795.
- [81] Borenstein Severin. The economics of fixed cost recovery by utilities. *Electr J* 2016;29(7):5–12.
- [82] Brown Toby, Faruqui Ahmad, Grausz Lea. Efficient tariff structures for distribution network services. *Econ Anal Policy* 2015;48:139–49.
- [83] Simshauser Paul. Distribution network prices and solar PV: Resolving rate instability and wealth transfers through demand tariffs. *Energy Econ* 2016;54:108–22.
- [84] IEA Paris. World energy outlook 2021. 2021, <https://www.iea.org/reports/world-energy-outlook-2021>.
- [85] Huber Matthias, Dimkova Desislava, Hamacher Thomas. Integration of wind and solar power in europe: Assessment of flexibility requirements. *Energy* 2014;69:236–46.
- [86] Swissolar. Detailanalyse des solarpotenzials auf dächern und fassaden. 2020, [https://www.swissolar.ch/fileadmin/user\\_upload/Swissolar/Top\\_Themen/Detailanalyse\\_Solarpotenzial\\_Schweiz.pdf](https://www.swissolar.ch/fileadmin/user_upload/Swissolar/Top_Themen/Detailanalyse_Solarpotenzial_Schweiz.pdf).